


A4- TYPICAL SCHEME DRAWING FOR CO2 FIRE SUPPRESSION SYSTEM FOR PAINT SHOP

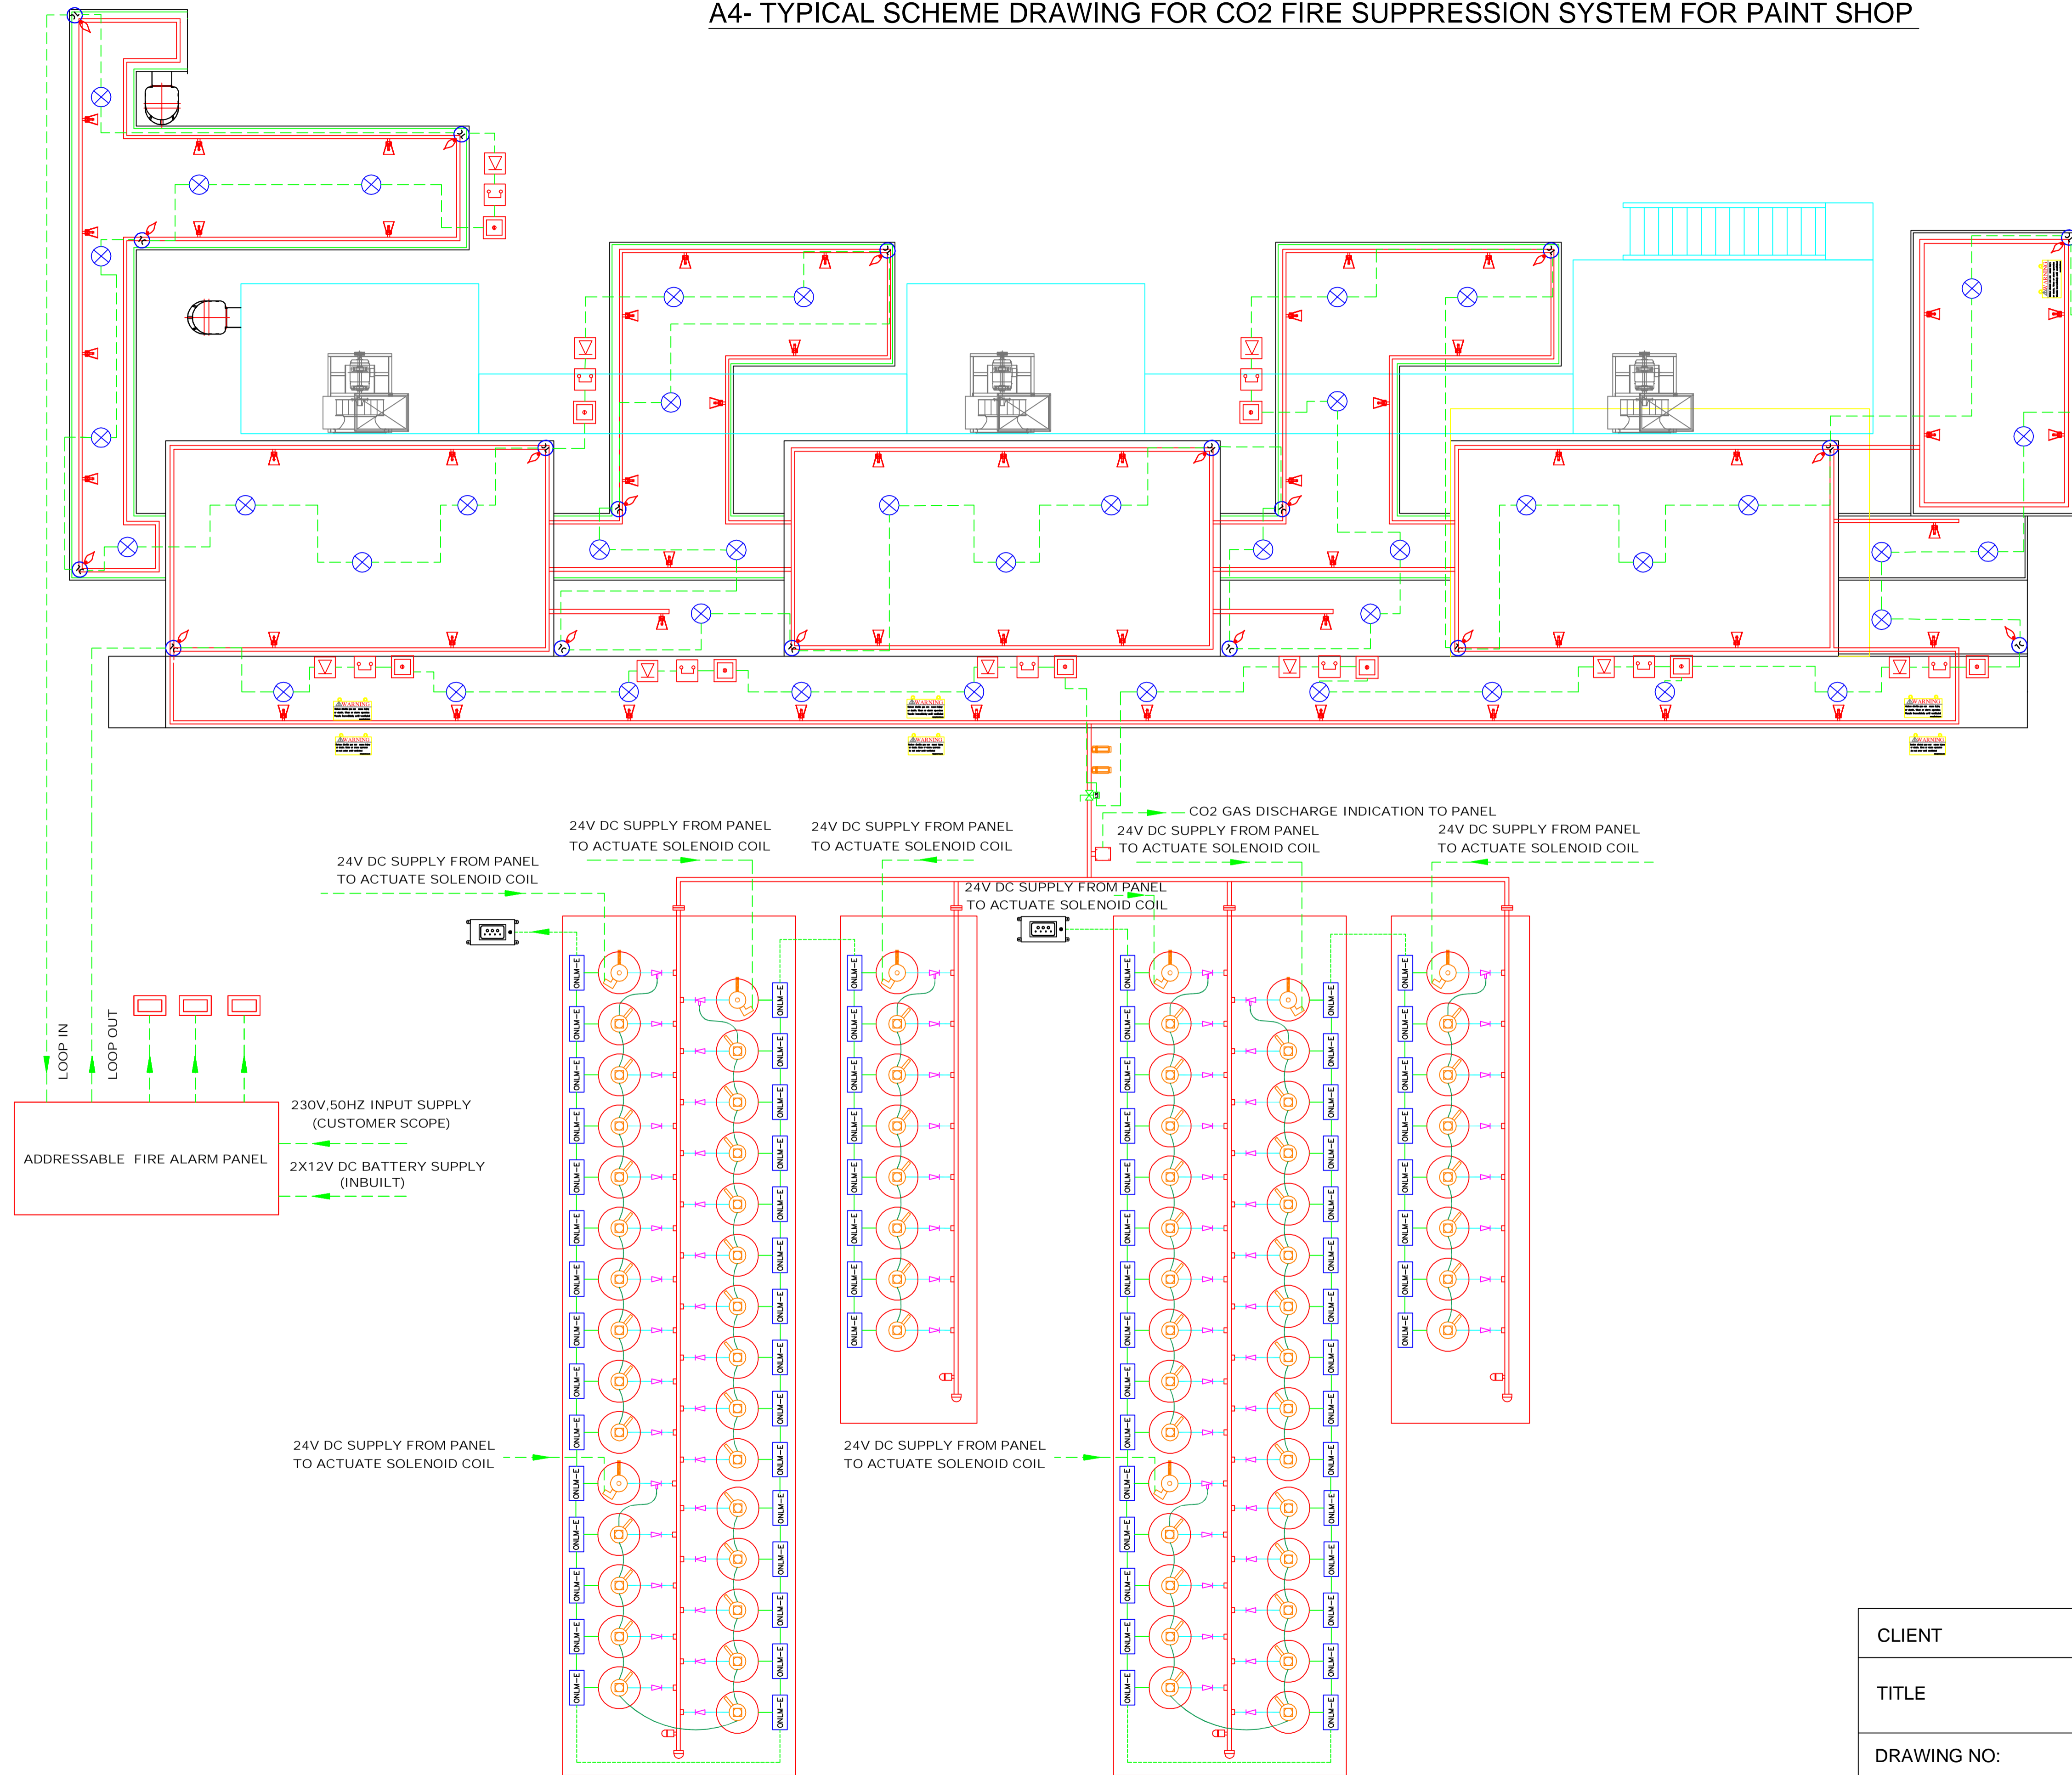

SI. NO.	NUMBERING & SYMBOL	PART NO.	DESCRIPTION	QTY.
01.		BIH001/MV-48/68	CO2 CYLINDER MASTER ASSEMBLY	8 NOS.
02.		BIH004/SV-48/68	CO2 CYLINDER SLAVE ASSEMBLY	68 NOS.
03.		BIH143-2	WEATHER PROOF PRESSURE SWITCH	1 NO.
04.		IH138	MANIFOLD SAFETY VALVE	4 NOS.
05.		IH012	CO2 NOZZLE WITH CONE HORN	54 NOS.
06.		BIH020	HIGH PRESSURE DISCHARGE HOSE - 400mm	68 NOS.
07.		BIH021	HIGH PRESSURE DISCHARGE HOSE - 350mm	8 NOS.
08.		IH018	NON-RETURN VALVE SUITABLE FOR CO2 MASTER CYLINDER	8 NOS.
09.		IH019	NON-RETURN VALVE SUITABLE FOR CO2 SLAVE CYLINDER	68 NOS.
10.		BIH022	HIGH PRESSURE ACTUATION HOSE - 550mm	24 NOS.
11.		BIH023	HIGH PRESSURE ACTUATION HOSE - 300mm	42 NOS.
12.		BIH381	HIGH PRESSURE ACTUATION HOSE - 1000mm	2 NOS.
13.		IH007R/NI	ONLINE MONITOR ANALOGUE LED TYPE WITH NORMAL INDICATION	76 NOS.
14.		IH009R/2A	ONLINE MONITOR CONTROL PANEL	2 NOS.
15.		IH388	SAFETY SIGN BOARD - VACATE IMMEDIATELY	4 NOS.
16.		IH388/1	SAFETY SIGN BOARD -DO NOT ENTER	4 NOS.
17.		IH147/2	ELECTRONIC DUAL TONE HOOTER WITH FLASHING LAMP FOR INDOOR APPLICATION	10 NOS.
18.		IH028-AD	INHIBIT SWITCH /ABORT SWITCH WITH ADDRESSABLE MODULE	10 NOS.
19.		IH029-AD	MANUAL GAS DISCHARGE INDICATION WITH ADDRESSABLE MODULE	10 NOS.
20.		IH237-50	50NB MANUAL LOCK OUT VALVE	1 NO.
21.		IH140-ETP	ELECTRICAL TRIP PANEL	3 NOS.
22.		IH042E-AD-60	PROBE TYPE HEAT DETECTOR WITH EXPLOSION PROOF JUNCTION BOX TEMPERATURE SETTING 60°C WITH ADDRESSABLE MODULE	42 NOS.
23.		IH225	TRIPLE SENSOR FLAME DETECTOR	18 NOS.
24.		IH324-30	WINTER GREEN ODORIZERS	2 NOS.
25.		BIH046/ADD/N	ADDRESSABLE FIRE ALARM PANEL	1 NO.
26.		ES04 049	2C X 1.5 Sq.mm cu.Arm'd FRLS CABLE.	1 LOT.
27.		BIH217*	* NB C.S SEAMLESS SCH.80 PIPE	1 LOT.

TENDER PURPOSE ONLY

(38+38) x 45 kg CO2 MAIN & STANDBY CYLINDER BANK

CLIENT	M/s. ROCKMAN INDUSTRIES.,					
TITLE	TYPICAL SCHEME DRAWING FOR CO2 FIRE SUPPRESSION SYSTEM FOR PAINT SHOP					
DRAWING NO:	REV	DESIGNED BY	TENDER TEAM	20-09-13	SCALE	SHEET NO.
DP-5.43/13-781	00	APPROVED BY	A.K	20-09-13	N.T.S	1 OF 1

AGNI CONTROLS CHENNAI

bala-wa