

DATA SHEET

MANUAL GAS DISCHARGE STATION FOR OUTDOOR APPLICATION

PART NO : IH029/1

OLD DWG. NO:DP-5.8/08-056 DATE : JUNE. 2013
NEW DOC. NO:DP-5.8/MT-092 DATE : JUL. 2022

REV.: 04

SCALE : N.T.S

SHEET : 1 OF 1


APPD. BY : DBS

INTRODUCTION :-


MANUAL GAS DISCHARGE STATION IS USED IN GAS BASED FIRE EXTINGUISHING SYSTEM FOR OUTDOOR APPLICATION. BY OPERATING DISCHARGE STATION, EXTINGUISHING GAS CAN BE DISCHARGED MANUALLY.

REVISION DETAILS:


REV 03: TERMINAL DETAILS UPDATED.

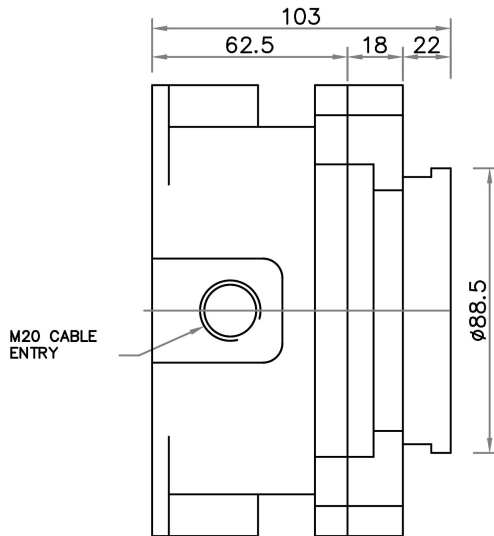

SIDE VIEW

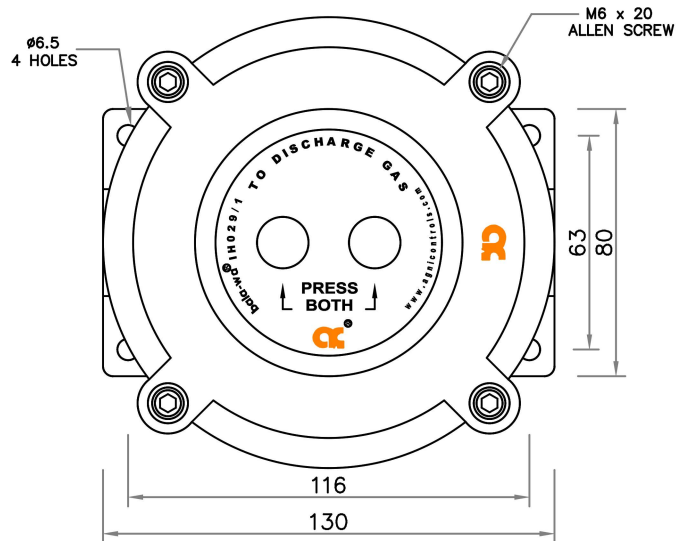


ELEVATION

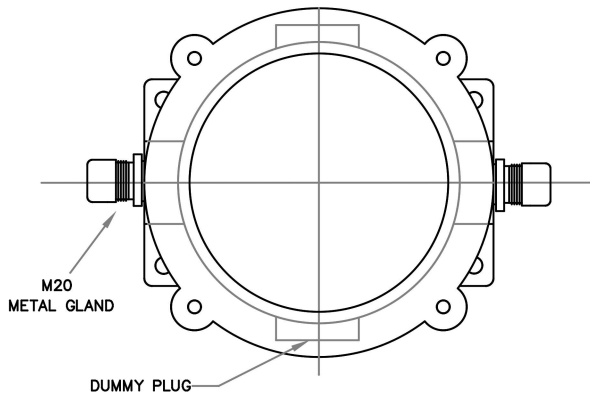


FRONT VIEW

TERMINAL DETAIL



EQUIVALENT CIRCUIT

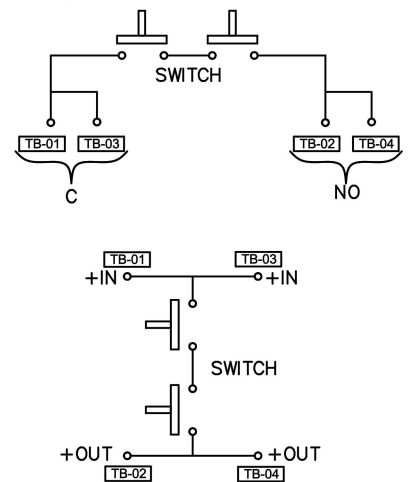

NOTE:

1. ALL DIMENSIONS ARE IN "mm" UNLESS OTHERWISE SPECIFIED.
2. TOLERANCE ON DIMENSION ± 3 MM, UNLESS OTHERWISE SPECIFIED.

TECHNICAL SPECIFICATION

01. MANUFACTURER	AGNI CONTROLS - CHENNAI	07. PROTECTION CLASS	IP65
02. MATERIAL	CAST ALUMINIUM LM6	08. TYPE OF MOUNTING	WALL MOUNTING
03. PAINTING PROCESS	POWDER COATING	09. OUTPUT	WHEN PUSH BUTTON OPERATED
04. COLOUR	SIGNAL RED - TEXTURED		POTENTIAL FREE CONTACT CHANGES
05. FASTENERS	SS 304		FROM 'NO' TO 'NC'.
06. CABLE ENTRY	M20x1.5 - 3 Nos.		

IMPORTANT:

AGNI CONTROLS RESERVES THE RIGHT TO CHANGE OR MODIFY WITHOUT PREVIOUS NOTICE ANY DATA OR SPECIFICATION DUE TO CHANGES OR MODIFICATION IN ORDER TO IMPROVE THE PRODUCTS / SYSTEM PRESENTED.



**AGNI CONTROLS
CHENNAI**

**ISO 9001 - 2015
CERTIFIED COMPANY**

NO.1, 6TH STREET, Dr.SUBBARAYAN NAGAR,
KODAMBAKKAM, CHENNAI-600 024, INDIA.

PHONE : +91 44 2481 2420

E-MAIL : engineering@agnicontrols.com WEBSITE : www.balafire.com