

**DATA SHEET**

**MANUAL GAS DISCHARGE STATION.**

PART NO : IH029

OLD DWG. NO:DP-5.8/08-055

DATE: JUL. 2022

REVISION : 02

SCALE : N.T.S

SHEET: 1 OF 1

APPD. BY : DBS


INTRODUCTION :-

MANUAL GAS DISCHARGE STATION IS USED IN GAS BASED FIRE EXTINGUISHING SYSTEM. BY OPERATING DISCHARGE STATION, EXTINGUISHING GAS CAN BE DISCHARGED MANUALLY.


NOTE:- THIS DATASHEET CAN BE ALSO REFERRED AS DOC. NO:DP-5.8/MT-090

REV-01: REV-01 IS THE SAME AS REV-00 EXCEPT FOR ADDING ISO 9001:2015.


REV-02: TERMINAL DETAILS UPDATED.

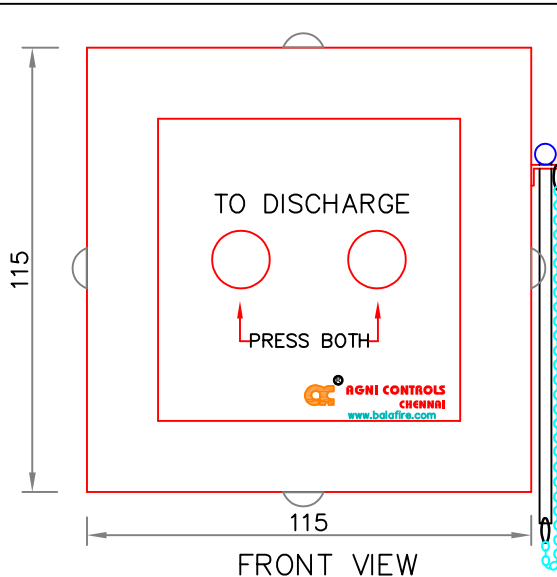

**FRONT VIEW**

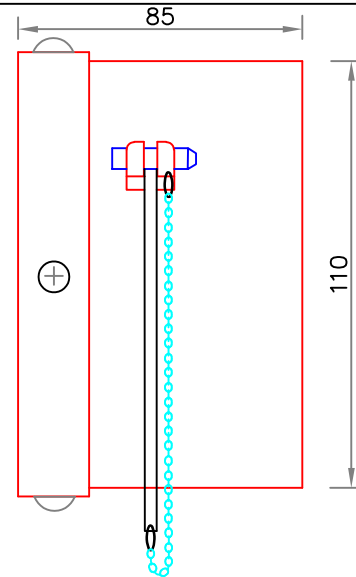


**SIDE VIEW**

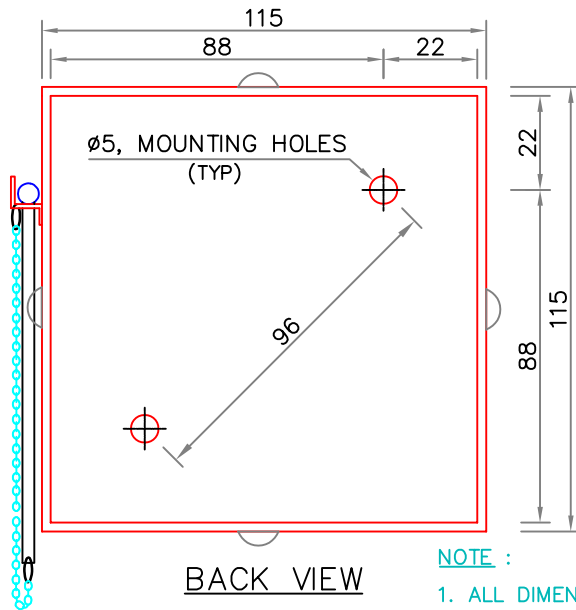


**BACK VIEW**

TERMINAL DETAIL



EQUIVALENT CIRCUIT

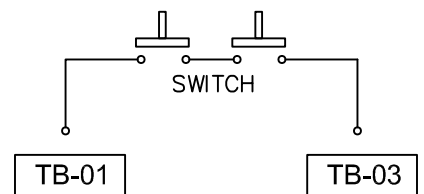

NOTE :

1. ALL DIMENSIONS ARE IN "mm" UNLESS OTHERWISE SPECIFIED.
2. TOLERANCE ON DIMENSION  $\pm 3$  MM, UNLESS OTHERWISE SPECIFIED.

**TECHNICAL SPECIFICATION**

01. DIMENSION	115 x 115 x 85mm	06. OUTPUT	WHEN PUSH BUTTON OPERATED POTENTIAL FREE CONTACT CHANGES FROM 'NO' TO 'NC'.
02. CONSTRUCTION	M.S SHEET JUNCTION BOX WITH HAMMER AND ROD.	07. INPUT	TO TB CONNECTED TO ZONE LINE OF ANY CONVENTIONAL FIRE ALARM CONTROL PANEL
04. COLOUR	TEXTURED FIRE RED (POWDER COATED).		
05. CABLE ENTRY	ø19mm KNOCKOUT HOLES		

IMPORTANT:

AGNI CONTROLS RESERVES THE RIGHT TO CHANGE OR MODIFY WITHOUT PREVIOUS NOTICE ANY DATA OR SPECIFICATION DUE TO CHANGES OR MODIFICATION IN ORDER TO IMPROVE THE PRODUCTS / SYSTEM PRESENTED.



**AGNI CONTROLS  
CHENNAI**

NO.1, 6TH STREET, Dr.SUBBARAYAN NAGAR,  
KODAMBAKKAM, CHENNAI-600 024, INDIA.

PHONE : +91 44 2481 2420,

E-MAIL : engineering@agnicontrols.com WEBSITE : www.balafire.com

**ISO 9001 - 2015  
CERTIFIED BY  
BUREAU VERITAS**