


fladet[®] SERIES...

DATA SHEET	PROBE TYPE HEAT DETECTOR (85-100)°C	PART NO :IH042-P1L *(85-100)°C
DOC.NO.:DP-5.8/MT-734	DATE:JUNE 2024	REVISION :04
	SCALE : N.T.S	SHEET: 1 OF 1
		APPD. BY : DBS

INTRODUCTION :-

PROBE TYPE FIXED TEMPERATURE HEAT DETECTOR IS USED IN SPECIAL APPLICATIONS. SUITABLE JUNCTION BOX(MS/SS/ALUMINIUM) MAY BE USED AS PER APPLICATION.
REVISION 04: TEMPERATURE RANGE UPDATED.

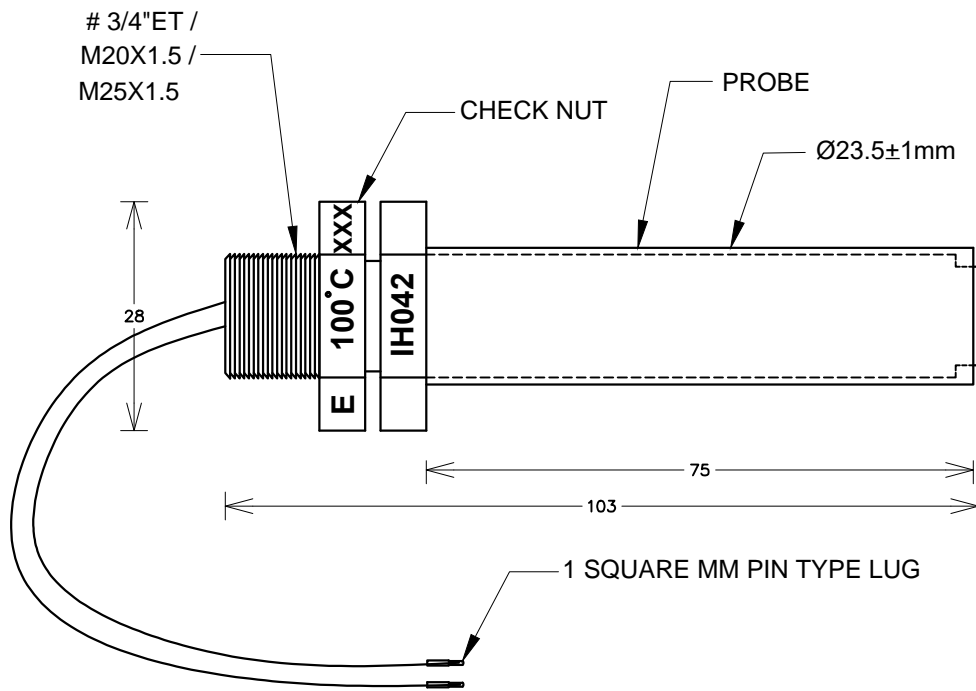

NOTE:

1. XXX :BATCH NUMBER
2. TOLERANCE ON DIMENSION : ± 3mm
3. XX :SENSOR IS TO BE PROTECTED FROM PHYSICAL DAMAGE PROTECTION COVER IS PROVIDED WITH DETECTOR. PROTECTION COVER SHOULD BE REMOVED ONLY DURING COMMISSIONING.
4. ALL DIMENSIONS ARE IN mm
5. * : TEMPERATURE SET POINT TO BE CONFIRMED DURING ORDER PLACEMENT.
6. # : THREAD SIZE TO BE CONFIRMED DURING ORDER PLACEMENT.

TECHNICAL SPECIFICATION

01.	MAKE	AGNI CONTROLS	07.	IP PROTECTION	IP 67
02.	TEMPERATURE SETTING	85°/90°/95°/100°C/ * (* - CUSTOMER SPECIFICATION)	08.	ADAPTOR CONNECTION	3/4"ET / M20X1.5 / M25X1.5
03.	TYPE OF SENSING ELEMENT	BI-METAL FIXED TEMPERATURE	09.	OPERATION	NORMALLY "NO". WHEN SET TEMPERATURE REACHES "NO" BECOMES "NC".
04.	TOLERANCE	± 5% UPTO 90°C AND ±7% FOR HIGHER TEMPERATURES	10.	SEALING	HERMATICALLY SEALED.
05.	CURRENT RATING	240V AC - 10A, 110V AC - 10A, 250V DC - 2.5A, 24V DC - 7A,			
06.	PROBE BODY	ALUMINIUM			

IMPORTANT:

AGNI CONTROLS RESERVES THE RIGHT TO CHANGE OR MODIFY WITHOUT PREVIOUS NOTICE ANY DATA OR SPECIFICATION DUE TO CHANGES OR MODIFICATION IN ORDER TO IMPROVE THE PRODUCTS / SYSTEM PRESENTED.

AGNI CONTROLS

ISO 9001 - 2015
CERTIFIED COMPANY

NO.1, 6TH STREET, Dr.SUBBARAYAN NAGAR,
KODAMBAKKAM, CHENNAI-600 024, INDIA.
PHONE : +91 44 2481 2420,
E-MAIL : engineering@agnicontrols.com WEBSITE : www.balafire.com