


A-2. TYPICAL SCHEME DRAWING OF bala-wa..5112 GAS FIRE EXTINGUISHING SYSTEM ALONG WITH FIRE DETECTION & ALARM SYSTEM FOR IT ROOM

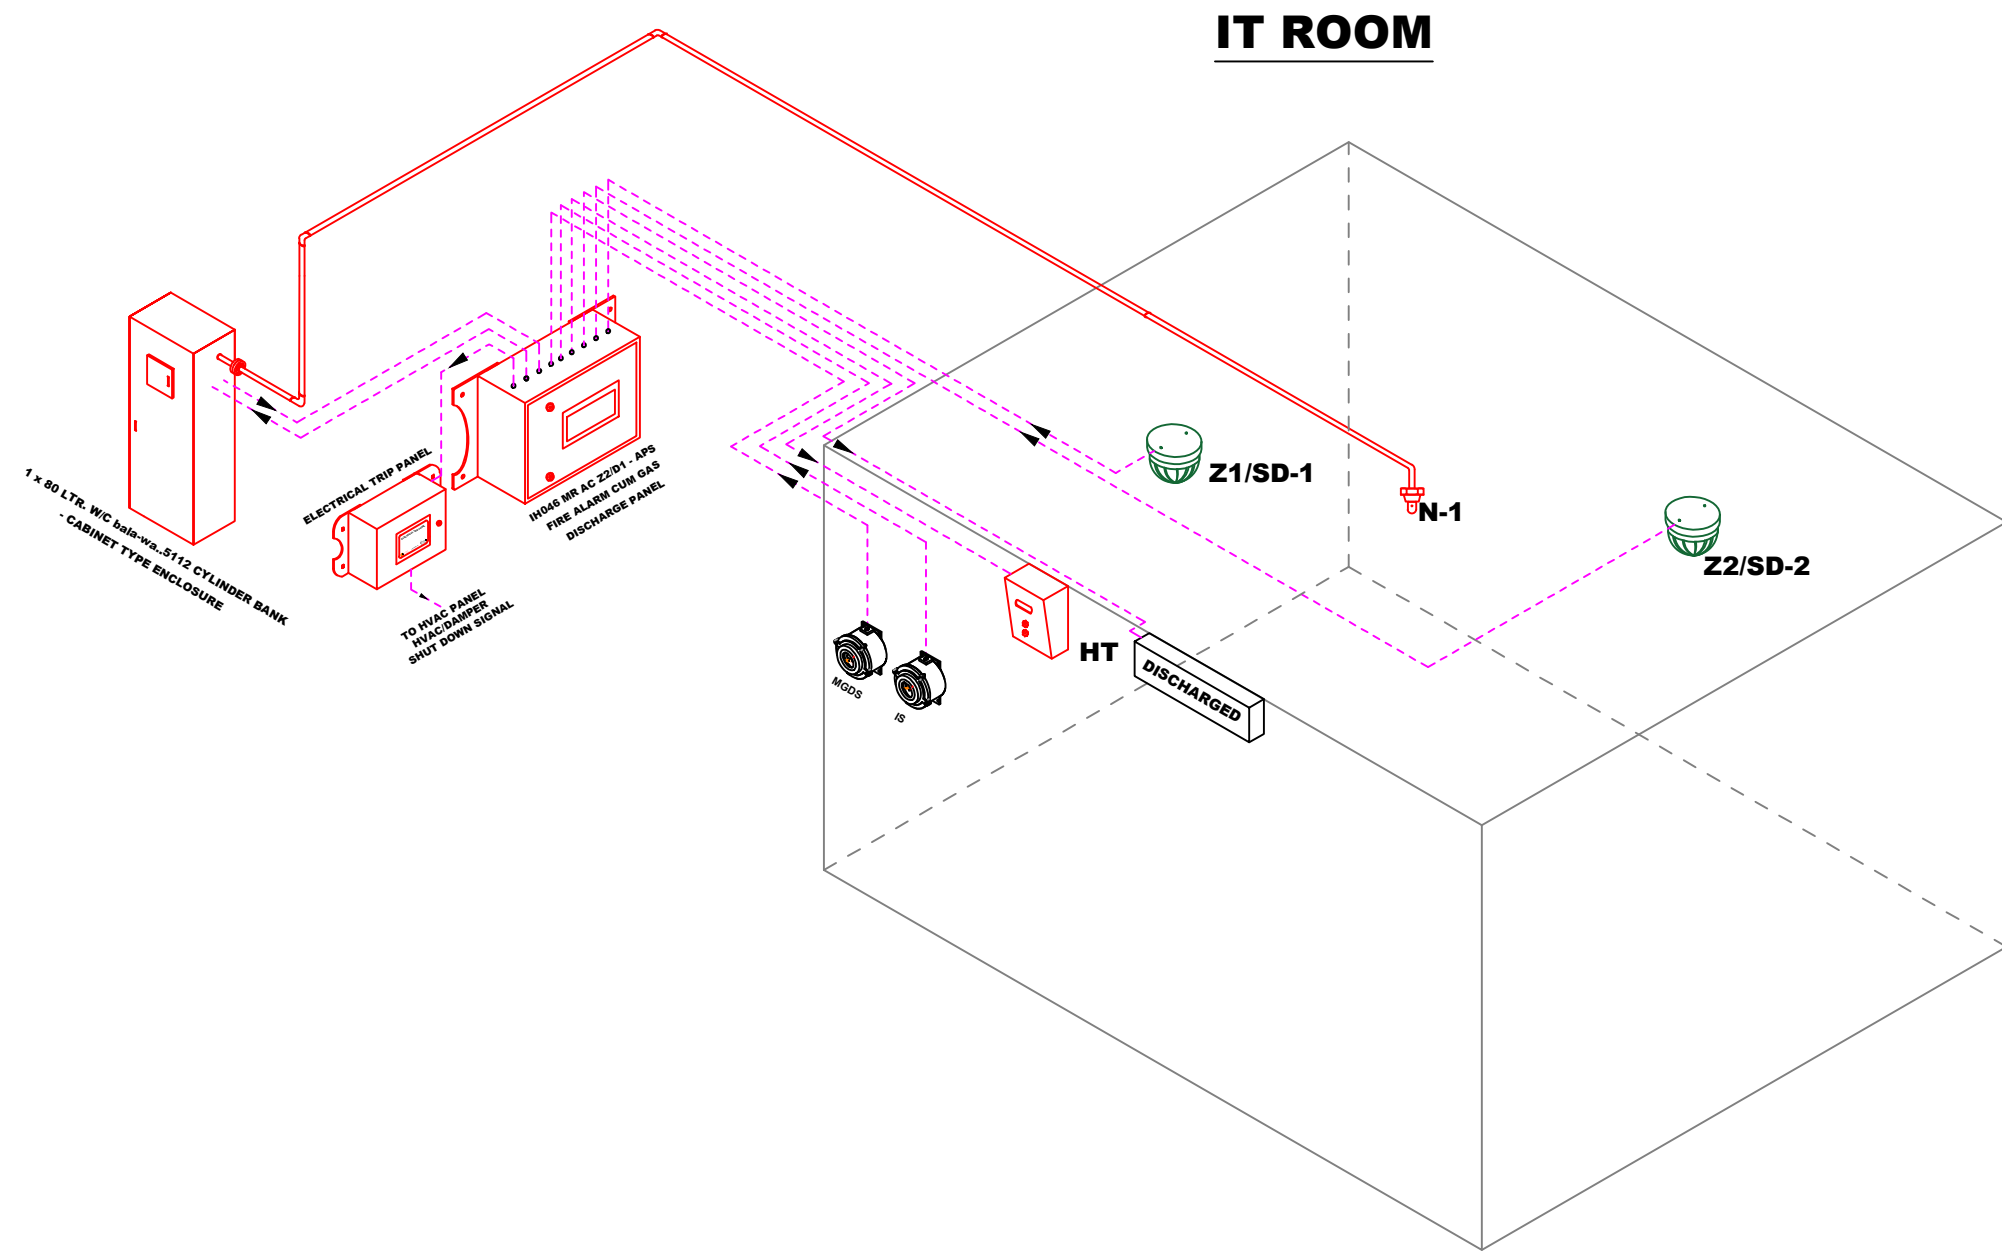

Sl. NO.	SYMBOL	PART NO.	DESCRIPTION
01.		IH901-80-1	bala-wa-5112 EXTINGUISHING CYLINDER BANK CABINET TYPE ENCLOSURE
02.		-	DISCHARGE NOZZLE
03.		IH046-MR AC Z2/D1-APS	CONVENTIONAL 2 ZONE FIRE ALARM CUM SINGLE GAS DISCHARGE PANEL
04.		-	WEATHER PROOF PRESSURE SWITCH
05.		BIH217-CS	C.S SEAMLESS Sch.40 PIPE
06.		IH029/1	MANUAL GAS DISCHARGE STATION SUITABLE SEMI OUTDOOR APPLICATION
07.		IH028/1	INHIBIT/ABORT SWITCH SUITABLE FOR SEMI OUTDOOR APPLICATION
08.		IH147	ELECTRONIC DUAL TONE HOOTER WITH FLASHING LAMP
09.		BIH155	CONVENTIONAL TYPE PHOTOELECTRIC TYPE SMOKE DETECTOR
10.		ES04 049	2C X 1.5 SQ.MM CU . ARMD. FRLS CABLE.
11.		IH388/2-NET-CS-24V DC	DISCHARGE DISPLAY UNIT
12.		IH140-ETP	ELECTRICAL TRIP PANEL

CLIENT	M/s. TRIANGLE ENGINEERING.,					
TITLE	TYPICAL SCHEME DRAWING OF bala-wa..5112 GAS FIRE EXTINGUISHING SYSTEM ALONG WITH FIRE DETECTION AND ALARM SYSTEM FOR IT ROOM					
DRAWING NO:	REV	DESIGNED BY	TENDER TEAM	25.07.2019	SCALE	SHEET NO.
DP-5.43/19-1618	00	APPROVED BY	A.K	25.07.2019	N.T.S	1 OF 1

TENDER PURPOSE ONLY

ISO 9001 - 2015
CERTIFIED BY
BUREAU VERITAS

AGNI CONTROLS
CHENNAI

bala-wa