

DATA SHEET

**CO₂ CYLINDER BANK SUITABLE FOR
2 CYLINDER WITH RAIL ASSEMBLY**

PART NO:
IH030-2S WD

DP-5.8/08-012

DATE : JAN 2012

REVISION : 02


SCALE : N.T.S

SHEET : 1 OF 1

APPD. BY: DB

INTRODUCTION :-

TYPICAL CO₂ CYLINDER BANK ARRANGEMENT FOR FIXED INSTALLATION CO₂ FIRE EXTINGUISHER SYSTEM SUITABLE FOR 68 LITRE WATER CAPACITY CYLINDERS OF 267mm DIA MAXIMUM.
REV 02:- REV 02 IS SAME AS REV 01 EXCEPT ADDING CODING.

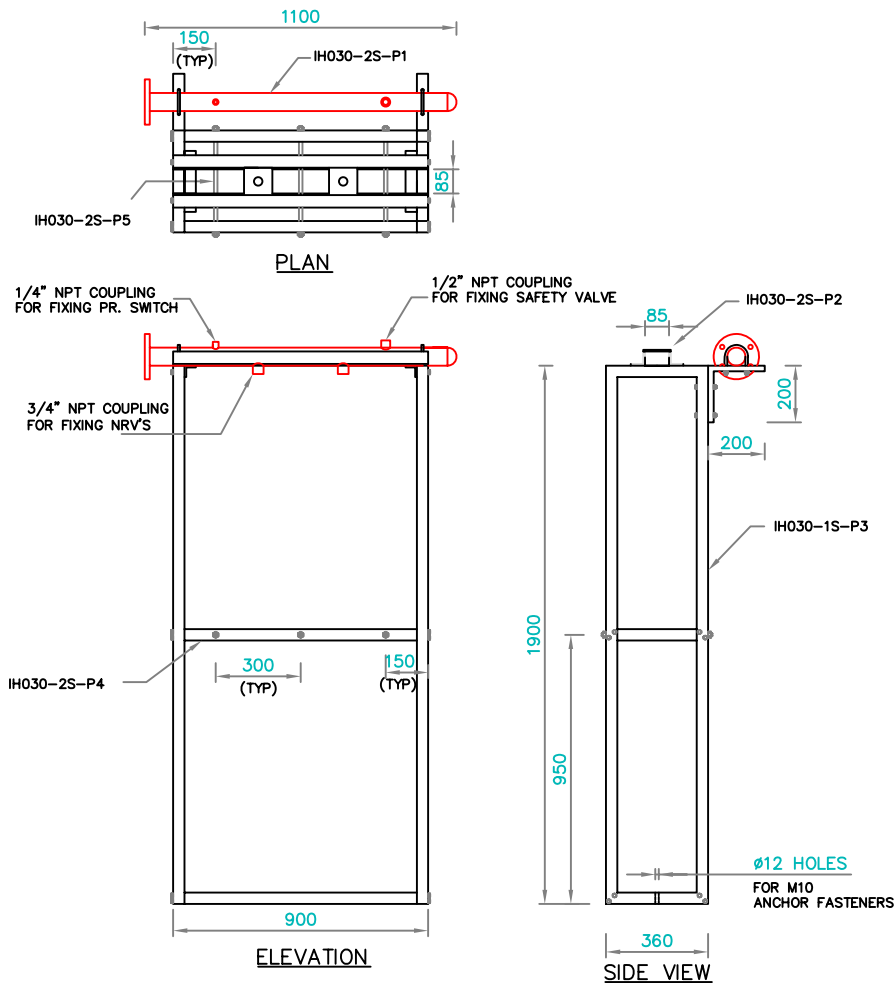

NOTE:

- ALL DIMENSIONS ARE IN "mm" UNLESS OTHERWISE SPECIFIED.
- TOLERANCE ON DIMENSION ± 3 MM, UNLESS OTHERWISE SPECIFIED.

TECHNICAL SPECIFICATION

01.	FRAME	MS 40x40x1.6 SQUARE TUBE POWDER COATING - SIEMENS GRAY TEXTURED FIXED WITH S.S. FASTENERS REMOVABLE	03.	RAIL ASSEMBLY	MS 50 x 50 x 6 (L - ANGLE) POWDER COATING - SIEMENS GRAY TEXTURED FIXED WITH S.S. FASTENERS REMOVABLE THROUGH BOTTOM FRAME
	(a) MATERIAL OF CONSTRUCTION			(a) MATERIAL OF CONSTRUCTION	
02.	HEADER	25NB M.S SEAMLESS SCH 80 ASTM A 106 TESTED AT 100 BAR PRESSURE FOR 10 MINUTES POWDER COATING - RED TEXTURED FIXED WITH S.S. FASTENERS REMOVABLE	04.	MOUNTING DETAIL	
	(a) MATERIAL OF CONSTRUCTION				
	(b) FINISH				
	(c) TYPE OF CONSTRUCTION				

IMPORTANT:

AGNI CONTROLS RESERVES THE RIGHT TO CHANGE OR MODIFY WITHOUT PREVIOUS NOTICE ANY DATA OR SPECIFICATION DUE TO CHANGES OR MODIFICATION IN ORDER TO IMPROVE THE PRODUCTS / SYSTEM PRESENTED.



ISO 9001 - 2008
CERTIFIED BY
BUREAU VERITAS

NO.1, 6TH STREET, Dr.SUBBARAYAN NAGAR,
KODAMBAKKAM, CHENNAI-600 024, INDIA.
PHONE : +91 44 2481 2420, FAX : +91 44 2481 2475,
E-MAIL : engineering@agnicontrols.com WEBSITE : www.balafire.com