

DATA SHEET

**CO2 CYLINDER BANK SUITABLE FOR
3 CYLINDER WITH RAIL ASSEMBLY**

PART NO:
IH030 -3S WD

DP-5.8/08-014

DATE : JAN 2012

REVISION : 02


SCALE : N.T.S

SHEET : 1 OF 2

APPD. BY: DB

INTRODUCTION :-

TYPICAL CO₂ CYLINDER BANK ARRANGEMENT FOR FIXED INSTALLATION CO₂ FIRE EXTINGUISHER SYSTEM SUITABLE FOR 60 LITRE /68 LITRE WATER CAPACITY CYLINDERS OF 267mm DIA MAXIMUM.REV 02:- REV 02 IS SAME AS REV 00 EXCEPT ADDING CODE.

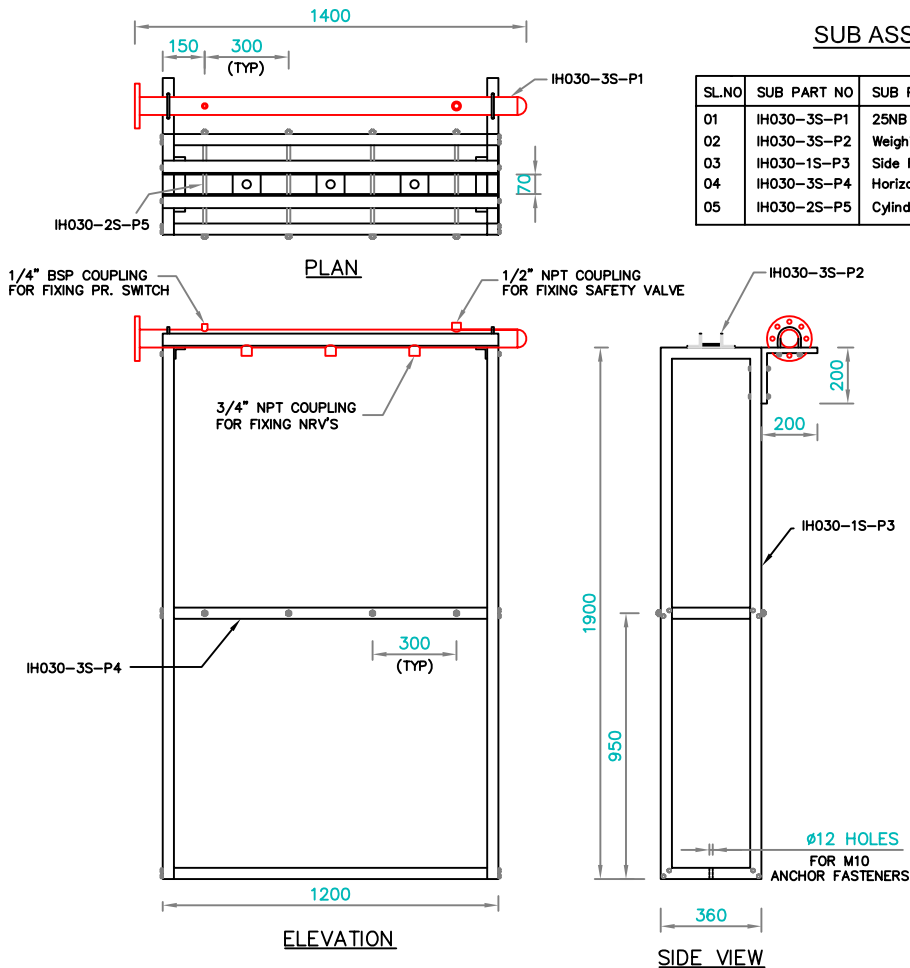

NOTE:

- 01. ALL DIMENSIONS ARE IN "mm" UNLESS OTHERWISE SPECIFIED.
- 02. TOLERANCE ON DIMENSION ± 3 mm, UNLESS OTHERWISE SPECIFIED.

TECHNICAL SPECIFICATION

01.	FRAME (a) MATERIAL OF CONSTRUCTION (b) FINISH (c) TYPE OF CONSTRUCTION	MS 40x40x1.6 SQUARE TUBE POWDER COATING - SIEMENS GRAY TEXTURED FIXED WITH S.S. FASTENERS REMOVABLE	03.	RAIL ASSEMBLY (a) MATERIAL OF CONSTRUCTION (b) FINISH (c) TYPE OF CONSTRUCTION	MS 50 x 50 x 6 (L - ANGLE) POWDER COATING - SIEMENS GRAY TEXTURED FIXED WITH S.S. FASTENERS REMOVABLE
02.	HEADER (a) MATERIAL OF CONSTRUCTION (b) FINISH (c) TYPE OF CONSTRUCTION	25NB M.S SEAMLESS SCH 80 ASTM A 106 TESTED AT 75 BAR PRESSURE FOR 5 MINUTES POWDER COATING - RED TEXTURED FIXED WITH S.S. FASTENERS REMOVABLE	04.	MOUNTING DETAIL	THROUGH BOTTOM FRAME

IMPORTANT:

AGNI CONTROLS RESERVES THE RIGHT TO CHANGE OR MODIFY WITHOUT PREVIOUS NOTICE ANY DATA OR SPECIFICATION DUE TO CHANGES OR MODIFICATION IN ORDER TO IMPROVE THE PRODUCTS / SYSTEM PRESENTED.



**AGNI CONTROLS
CHENNAI**

NO.1, 6TH STREET, Dr.SUBBARAYAN NAGAR,
KODAMBAKKAM, CHENNAI-600 024, INDIA.

PHONE : +91 44 2481 2420, FAX : +91 44 2481 2475,

E-MAIL : engineering@agnicontrols.com WEBSITE : www.balafire.com

ISO 9001 - 2008
CERTIFIED BY
BUREAU VERITAS