


DATA SHEET	CO2 CYLINDER BANK FRAME ASSEMBLY SUITABLE FOR 6 CYLINDER WITH RAIL ASSEMBLY	PART NO: IH030-6 S WD
-------------------	--	--------------------------

DP-5.8/08-020	DATE: JAN 2012	REVISION : 01	SCALE : N.T.S	SHEET : 1 OF 1	APPD. BY: DB
---------------	----------------	---------------	---------------	----------------	--------------

INTRODUCTION :-

TYPICAL CO₂ CYLINDER BANK FRAME ASSEMBLY ARRANGEMENT FOR FIXED INSTALLATION CO₂ FIRE EXTINGUISHER SYSTEM SUITABLE FOR 60 LITRE /68 LITRE WATER CAPACITY CYLINDERS OF 267mm DIA MAXIMUM.
 REV 01:- REV 01 IS SAME AS REV 00 EXCEPT CHANGE IN THE RAIL ASSEMBLY AND ADDING CODE NUMBER.

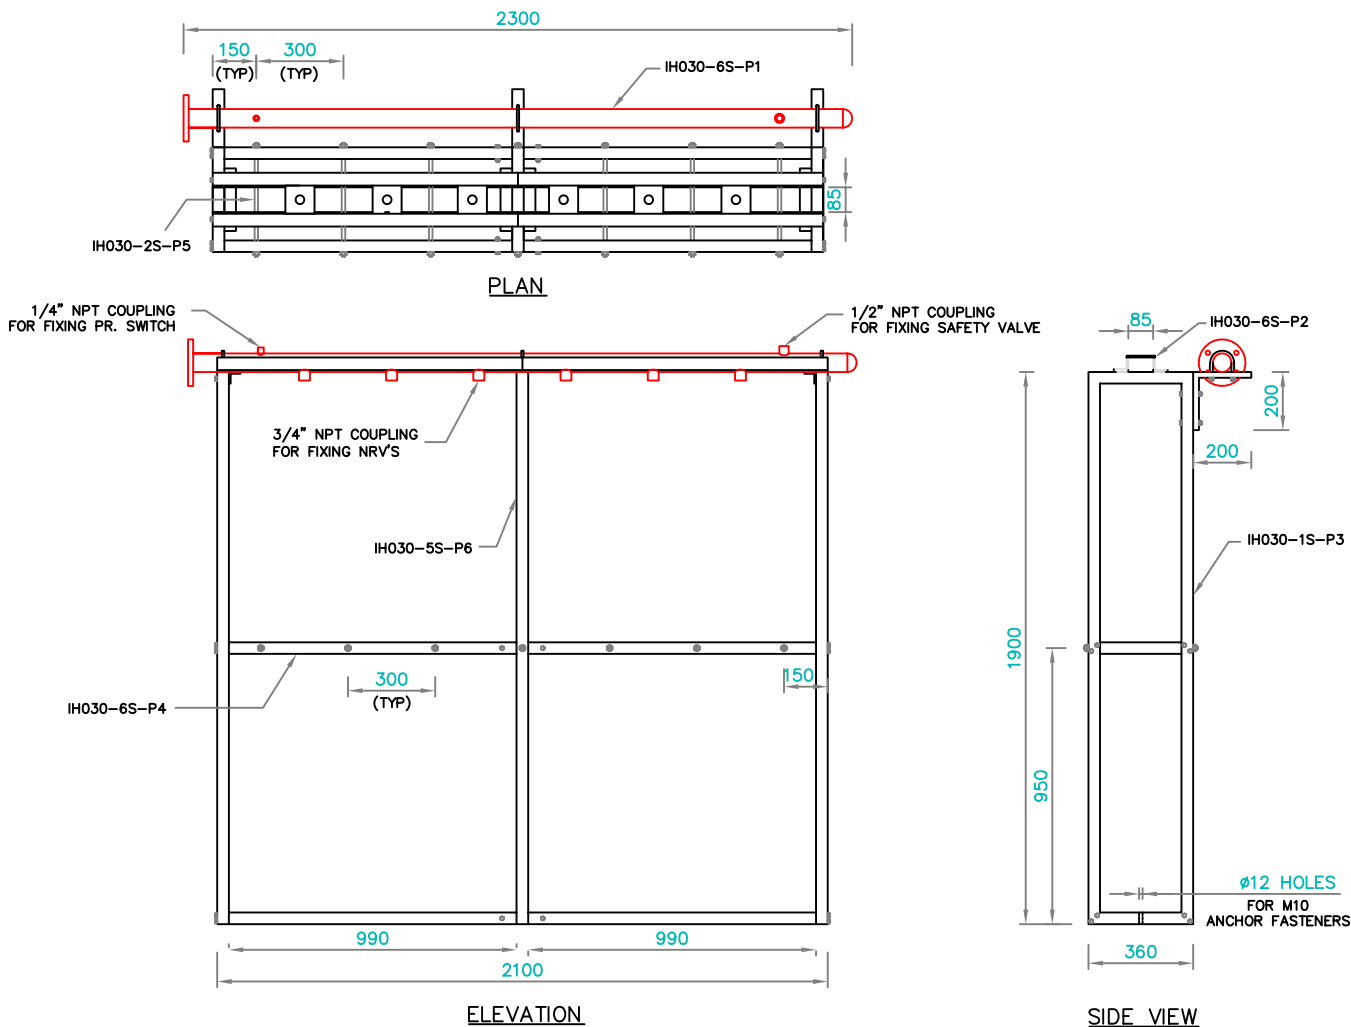

NOTE:
 01. ALL DIMENSIONS ARE IN "mm" UNLESS OTHERWISE SPECIFIED.
 02. TOLERANCE ON DIMENSION ± 3mm, UNLESS OTHERWISE SPECIFIED.

TECHNICAL SPECIFICATION

01.	FRAME ASSEMBLY (a) MATERIAL OF CONSTRUCTION (b) FINISH (c) TYPE OF CONSTRUCTION	MS 40x40x1.6 SQUARE TUBE POWDER COATING - SIEMENS GRAY TEXTURED FIXED WITH S.S. FASTENERS REMOVABLE	03.	RAIL ASSEMBLY (a) MATERIAL OF CONSTRUCTION (b) FINISH (c) TYPE OF CONSTRUCTION	MS 50 x 50 x 6 (L - ANGLE) POWDER COATING - SIEMENS GRAY TEXTURED FIXED WITH S.S. FASTENERS REMOVABLE
02.	HEADER (a) MATERIAL OF CONSTRUCTION (b) FINISH (c) TYPE OF CONSTRUCTION	32NB M.S SEAMLESS SCH 80 ASTM A 106 TESTED AT 100 BAR PRESSURE FOR 10 MINUTES POWDER COATING - RED TEXTURED FIXED WITH S.S. FASTENERS REMOVABLE	04.	MOUNTING DETAIL	THROUGH BOTTOM FRAME

IMPORTANT:

AGNI CONTROLS RESERVES THE RIGHT TO CHANGE OR MODIFY WITHOUT PREVIOUS NOTICE ANY DATA OR SPECIFICATION DUE TO CHANGES OR MODIFICATION IN ORDER TO IMPROVE THE PRODUCTS / SYSTEM PRESENTED.



NO.1, 6TH STREET, Dr.SUBBARAYAN NAGAR,
 KODAMBAKKAM, CHENNAI-600 024, INDIA.
 PHONE : +91 44 2481 2420, FAX : +91 44 2481 2475,
 E-MAIL : engineering@agnicontrols.com WEBSITE : www.balafire.com

ISO 9001 - 2008
 CERTIFIED BY
 BUREAU VERITAS