


INTRODUCTION :-

MANUAL RELEASE UNIT IS USED IN GAS BASED FIRE EXTINGUISHING SYSTEM. BY OPERATING DISCHARGE RELEASE UNIT, EXTINGUISHING GAS CAN BE DISCHARGED MANUALLY.

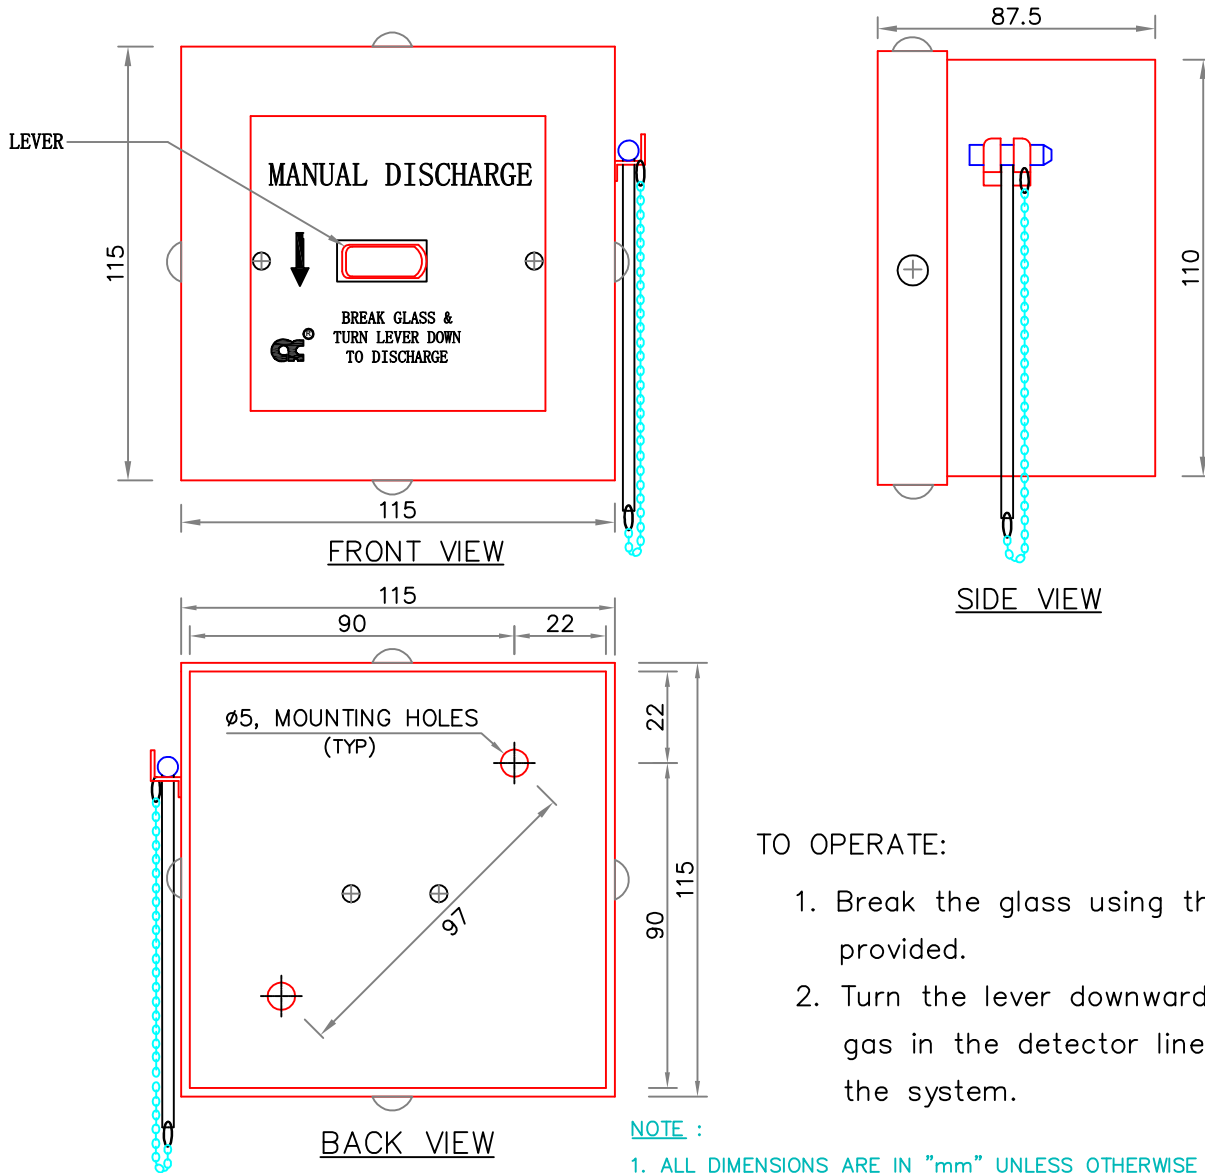

TO OPERATE:

1. Break the glass using the hammer provided.
2. Turn the lever downward to release gas in the detector line & operate the system.

NOTE :

1. ALL DIMENSIONS ARE IN "mm" UNLESS OTHERWISE SPECIFIED.
2. TOLERANCE ON DIMENSION ± 3 MM, UNLESS OTHERWISE SPECIFIED.
3. THIS UNIT TO BE USED ONLY WITH INDIRECT SYSTEM.

TECHNICAL SPECIFICATION

01.	DIMENSION	115 x 115 x 87.5mm	06.	INPUT CONNECTION	FIRE DETECTION TUBE
02.	CONSTRUCTION	M.S SHEET JUNCTION BOX WITH HAMMER AND ROD.			
04.	COLOUR	TEXTURED SIGNAL RED (POWDER COATED)			
05.	CABLE ENTRY	Ø19mm KNOCKOUT HOLES			

IMPORTANT:

AGNI CONTROLS RESERVES THE RIGHT TO CHANGE OR MODIFY WITHOUT PREVIOUS NOTICE ANY DATA OR SPECIFICATION DUE TO CHANGES OR MODIFICATION IN ORDER TO IMPROVE THE PRODUCTS / SYSTEM PRESENTED.



**AGNI CONTROLS
CHENNAI**

NO.1, 6TH STREET, Dr.SUBBARAYAN NAGAR,
KODAMBAKKAM, CHENNAI-600 024, INDIA.

PHONE : +91 44 2481 2420,

E-MAIL : engineering@agnicontrols.com WEBSITE : www.balafire.com

ISO 9001 - 2015
BUREAU VERITAS
CERTIFICATION