

DATA SHEET

GAS INHIBIT SWITCH INBUILT ADDRESSABLE MODULE FOR INDOOR APPLICATION

PART NO :
IH028-AD

FIRST ISSUE DOC. NO:DP-5.8/09-184

DATE: SEP. 2020

REV.: 02

SCALE : N.T.S


SHEET : 1 OF 1

APPD. BY: DBS

INTRODUCTION :-

THE SELECTOR SWITCH MOUNTED IN THE BOX WILL HAVE ONE 'NC' CONTACT WITH INBUILT ADDRESSABLE MODULE. THE BOX IS COVERED WITH FRONT COVER WHICH WILL BE SEALED BY MEANS OF BREAKABLE GLASS. THE SELECTOR SWITCH SHOULD BE IN THE 'DISCHARGE MODE' IN NORMAL CONDITION. THE SWITCH SHOULD BE CHANGED TO 'INHIBIT MODE' TO INHIBIT OR ABORT THE DISCHARGE SIGNAL TO THE CYLINDER SOLENOID VALVES.

REV-02 - CHANGES IN TECHNICAL SPECIFICATION & CONNECTION DETAIL.

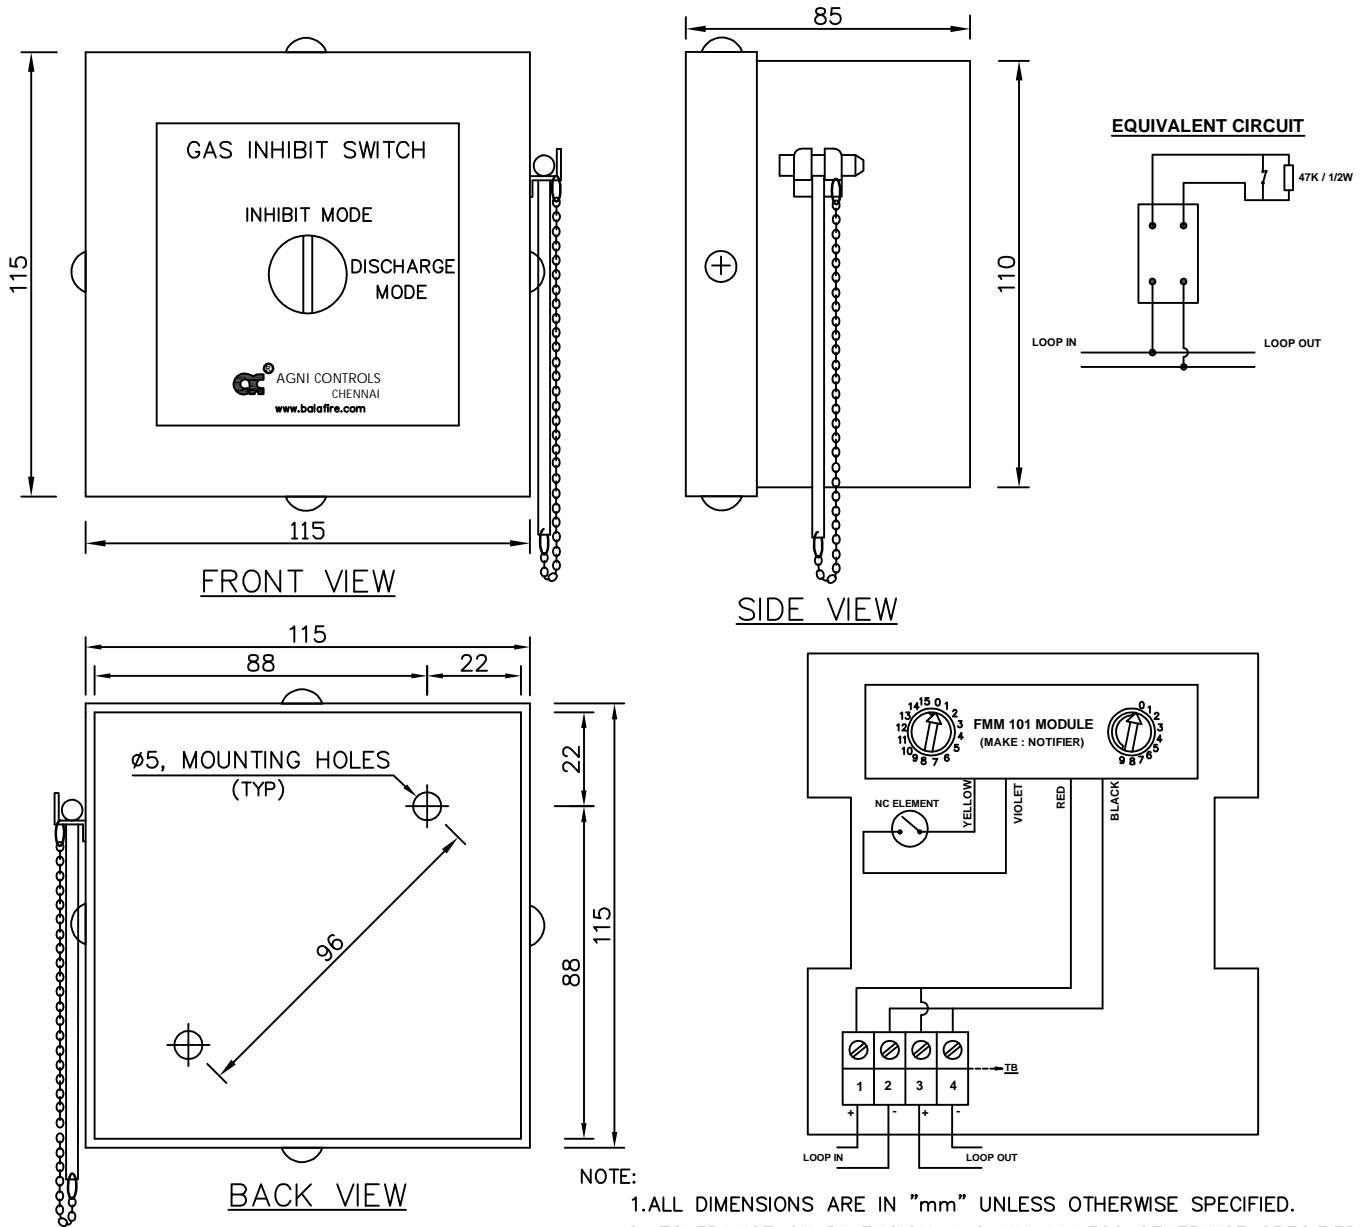

NOTE:

1. ALL DIMENSIONS ARE IN "mm" UNLESS OTHERWISE SPECIFIED.
2. TOLERANCE ON DIMENSION ± 2 MM, UNLESS OTHERWISE SPECIFIED.

TECHNICAL SPECIFICATION

01.	DIMENSION	115 x 115 x 85mm	05.	OPERATION	
02.	CONSTRUCTION	M.S SHEET METAL BODY WITH HAMMER AND ROD.	I.	DISCHARGE MODE	CONTACT IS NORMALLY OPEN (NO)
03.	COLOUR	PO RED (POWDER COATED)	II.	INHIBIT MODE	CONTACT IS NORMALLY CLOSED (NC)
04.	CABLE ENTRY	\varnothing 19mm KNOCKOUT HOLES			

IMPORTANT:

AGNI CONTROLS RESERVES THE RIGHT TO CHANGE OR MODIFY WITHOUT PREVIOUS NOTICE ANY DATA OR SPECIFICATION DUE TO CHANGES OR MODIFICATION IN ORDER TO IMPROVE THE PRODUCTS / SYSTEM PRESENTED.



**AGNI CONTROLS
CHENNAI**

ISO 9001 - 2015
CERTIFIED COMPANY

NO.1, 6TH STREET, Dr.SUBBARAYAN NAGAR,
KODAMBAKKAM, CHENNAI-600 024, INDIA.

PHONE : +91 44 2481 2420

E-MAIL : engineering@agnicontrols.com WEBSITE : www.balafire.com