

## **DATA SHEET**

# MANUAL GAS DISCHARGE STATION.

PART NO: IH029

OLD DWG. NO: DP-5.8/08-055

NEW DOC. NO: DP-5.8/MT-090

**DATE: JUN. 2019** 

**REVISION: 01** 

SCALE: N.T.S

SHEET: 1 OF 1


APPD. BY: DBS

#### INTRODUCTION :-

MANUAL GAS DISCHARGE STATION IS USED IN GAS BASED FIRE EXTINGUISHING SYSTEM. BY OPERATING DISCHARGE STATION, EXTINGUISHING GAS CAN BE DISCHARGED MANUALLY.

NOTE: - THIS DATASHEET CAN BE ALSO REFERRED AS DOC. NO: DP-5.8/CP-090

REV-01: REV-01 IS THE SAME AS REV-00 EXCEPT FOR ADDING ISO 9001: 2015.

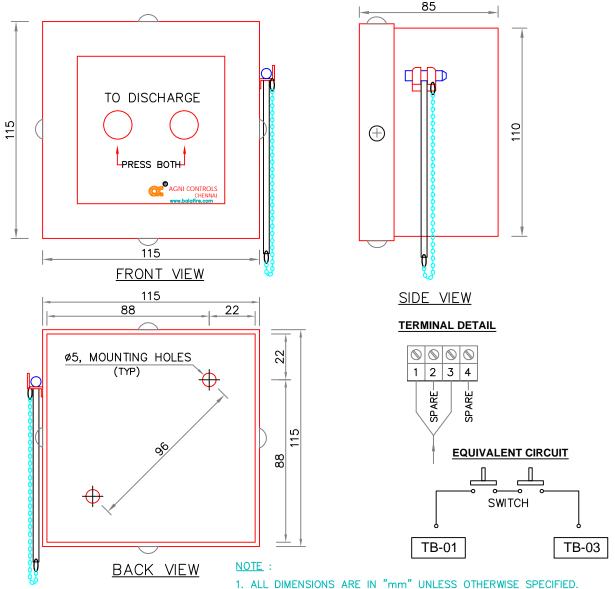

2. TOLERANCE ON DIMENSION  $\pm$  3 MM, UNLESS OTHERWISE SPECIFIED.

TECHNICAL SPECIFICATION					
01.	DIMENSION	115 x 115 x 85mm	06.	OUTPUT	WHEN PUSH BUTTON OPERATED
02.	CONSTRUCTION	M.S SHEET JUNCTION BOX WITH HAMMER AND ROD.			POTENTIAL FREE CONTACT CHANGES FROM 'NO' TO 'NC'.
04. 05.	COLOUR CABLE ENTRY	TEXTURED FIRE RED (POWDER COATED). ø19mm KNOCKOUT HOLES	07.	INPUT	TO TB CONNECTED TO ZONE LINE OF ANY CONVENTIONAL FIRE ALARM CONTROL PANEL

### **IMPORTANT:**

AGNI CONTROLS RESERVES THE RIGHT TO CHANGE OR MODIFY WITHOUT PREVIOUS NOTICE ANY DATA OR SPECIFICATION DUE TO CHANGES OR MODIFICATION IN ORDER TO IMPROVE THE PRODUCTS / SYSTEM PRESENTED.



ISO 9001 - 2015 **CERTIFIED BY CHENNAI BUREAU VERITAS** NO.1, 6TH STREET, Dr.SUBBARAYAN NAGAR,

KODAMBAKKAM, CHENNAI-600 024, INDIA.

PHONE: +91 44 2481 2420,

 $E-MAIL : engineering@agnicontrols.com \ WEBSITE : www.balafire.com$