

DATA SHEET

CO₂ CYLINDER BANK SUITABLE FOR 5 CYLINDER WITH RAIL ASSEMBLY

PART NO:
IH030-5S WD

DP-5.8/MT-169

DATE : JUNE 2019

REVISION : 01

SCALE : N.T.S


SHEET : 1 OF 1

APPD. BY:DBS

INTRODUCTION :-

TYPICAL CO₂ CYLINDER BANK ARRANGEMENT FOR FIXED INSTALLATION CO₂ FIRE EXTINGUISHER SYSTEM SUITABLE FOR 68 LITRE WATER CAPACITY CYLINDERS OF 267mm DIA MAXIMUM.

REV-01: REV-01 IS THE SAME AS REV-00 EXCEPT FOR ADDING ISO 9001:2015

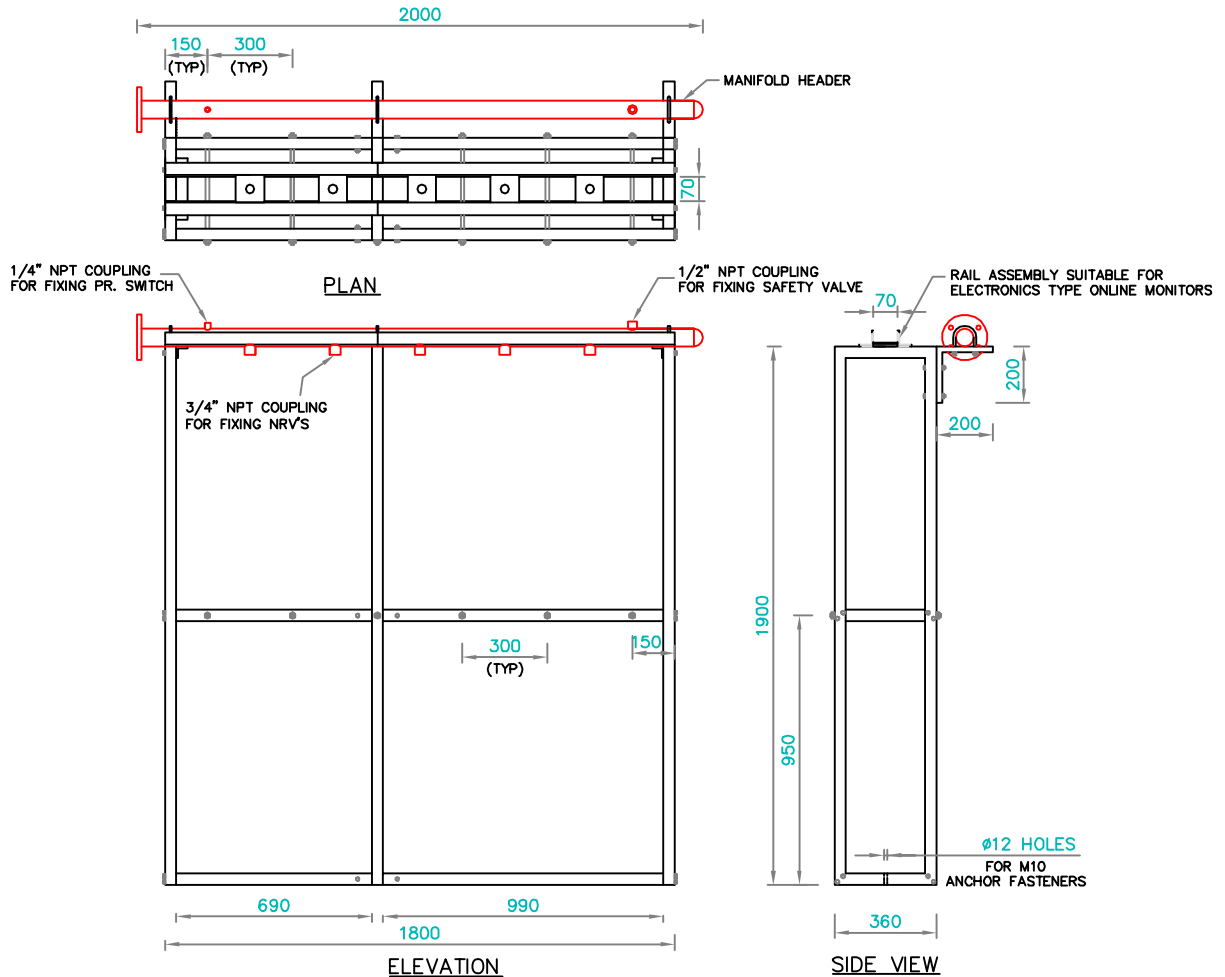

NOTE:

01. ALL DIMENSIONS ARE IN "mm" UNLESS OTHERWISE SPECIFIED.
02. TOLERANCE ON DIMENSION ± 3 mm, UNLESS OTHERWISE SPECIFIED.

TECHNICAL SPECIFICATION

01.	<p>FRAME</p> <p>(a) MATERIAL OF CONSTRUCTION</p> <p>(b) FINISH</p> <p>(c) TYPE OF CONSTRUCTION</p>	<p>MS 40x40x1.6 SQUARE TUBE</p> <p>POWDER COATING - 'L' GRAY TEXTURED</p> <p>FIXED WITH S.S. FASTENERS (REMOVABLE)</p>	03.	<p>RAIL ASSEMBLY</p> <p>(a) MATERIAL OF CONSTRUCTION</p> <p>(b) FINISH</p> <p>(c) TYPE OF CONSTRUCTION</p>	<p>MS 50 x 50 x 6 (L - ANGLE)</p> <p>POWDER COATING - 'L' GRAY TEXTURED</p> <p>FIXED WITH S.S. FASTENERS (REMOVABLE)</p>
02.	<p>HEADER</p> <p>(a) MATERIAL OF CONSTRUCTION</p> <p>(b) FINISH</p> <p>(c) TYPE OF CONSTRUCTION</p>	<p>32NB M.S SEAMLESS SCH 80</p> <p>ASTM A 106 TESTED AT 100 BAR PRESSURE FOR 10 MINUTES</p> <p>POWDER COATING - RED TEXTURED</p> <p>FIXED WITH S.S. FASTENERS (REMOVABLE)</p>	04.	<p>MOUNTING DETAIL</p>	<p>THROUGH BOTTOM FRAME</p>

IMPORTANT:

AGNI CONTROLS RESERVES THE RIGHT TO CHANGE OR MODIFY WITHOUT PREVIOUS NOTICE ANY DATA OR SPECIFICATION DUE TO CHANGES OR MODIFICATION IN ORDER TO IMPROVE THE PRODUCTS / SYSTEM PRESENTED.



NO.1, 6TH STREET, Dr.SUBBARAYAN NAGAR, KODAMBAKKAM, CHENNAI-600 024, INDIA.

PHONE : +91 44 2382 0774, FAX : +91 44 2481 2475, E-MAIL : operation@agnicontrols.com WEBSITE : www.balafire.com

**ISO 9001 - 2015
CERTIFIED BY
BUREAU VERITAS**