

<b>DATA SHEET</b>	<b>ELECTRONIC HOOTER WITH FLASHING LAMP</b>	PART NO : IH147
-------------------	---	-----------------


OLD DWG. NO:DP-5.8/08-058	DATE : NOV. 2013	REV: 01	SCALE : N.T.S	SHEET : 1 OF 1	APPD. BY :
NEW DOC. NO:DP-5.8/MT-121	DATE : APR. 2014				

REV-01-APR.2014: CHANGES IN TECHNICAL SPECIFICATION.

**INTRODUCTION :-**

DUAL TONE HOOTER WITH FLASHING LAMP IS USED IN FIRE DETECTION SYSTEM THROUGH FIRE ALARM PANEL.

NOTE : THIS DATASHEET CAN BE ALSO REFERRED AS NEW DOC. NO:DP-5.8/CP-121

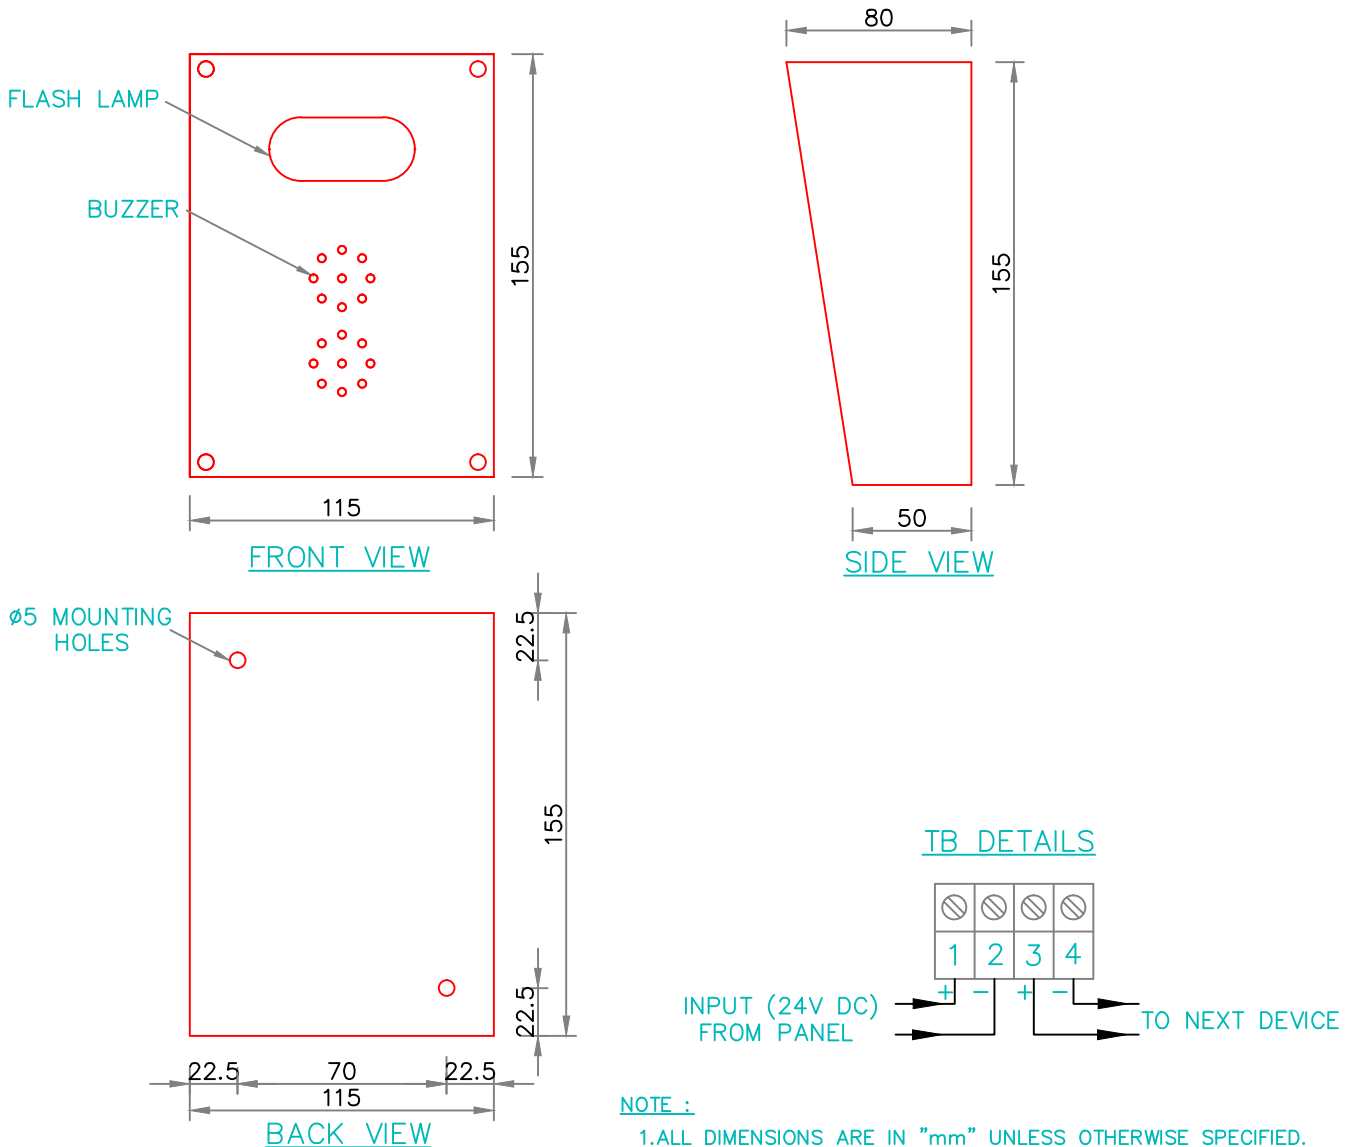

**NOTE :**  
 1. ALL DIMENSIONS ARE IN "mm" UNLESS OTHERWISE SPECIFIED.  
 2. TOLERANCE ON DIMENSION  $\pm 3$  MM, UNLESS OTHERWISE SPECIFIED.

**TECHNICAL SPECIFICATION**

01.	MAKE	balawa.. AGNICONROLS	07.	TYPE OF TONE	DUAL TONE
02.	OVER ALL DIMENSION	115(L) x 80(W)x 155(H)	08.	DB LEVEL	90<100 AT 24V DC AT 1M DISTANCE
03.	MATERIAL OF CONSTRUCTION	1.2mm (18 SWG) C.R SHEET	09.	FLASHING	RED LED
04.	FINISHING	PO RED	10.	CABLE ENTRY	BOTTOM ENTRY – $\phi$ 19mm KNOCK OUT
05.	WORKING VOLTAGE	24V DC	11.	TYPE OF MOUNTING	WALL MOUNTING
06.	CURRENT CONSUMPTION	350 mA MAX			

<p><b>IMPORTANT:</b>                  AGNI CONTROLS RESERVES THE RIGHT TO CHANGE OR MODIFY WITHOUT PREVIOUS NOTICE ANY DATA OR SPECIFICATION DUE TO CHANGES OR MODIFICATION IN ORDER TO IMPROVE THE PRODUCTS / SYSTEM PRESENTED.</p>	<p><b>AGNI CONTROLS CHENNAI</b>                  NO.1, 6TH STREET, Dr.SUBBARAYAN NAGAR, KODAMBAKKAM, CHENNAI-600 024, INDIA.                  PHONE : +91 44 2481 2420, FAX : +91 44 2481 2475,                  E-MAIL : engineering@agnicontrols.com WEBSITE : www.balafire.com</p>
--	---

ISO 9001 - 2008  
 CERTIFIED BY  
 BUREAU VERITAS