

DATA SHEET

ELECTRONIC HOOTER WITH FLASHING LAMP

PART NO : IH147

OLD DWG. NO:DP-5.8/08-058
NEW DOC. NO:DP-5.8/MT-121

DATE: JUN. 2019

REV: 02

SCALE : N.T.S

SHEET : 1 OF 1


APPD. BY : *[Signature]*

REV-01-APR.2014: CHANGES IN TECHNICAL SPECIFICATION.
REV-02-JUN.2019: REV-02 IS THE SAME AS REV-01 EXCEPT FOR ADDING ISO 9001:2015.

INTRODUCTION :-

DUAL TONE HOOTER WITH FLASHING LAMP IS USED IN FIRE DETECTION SYSTEM THROUGH FIRE ALARM PANEL.

NOTE : THIS DATASHEET CAN BE ALSO REFERRED AS NEW DOC. NO:DP-5.8/CP-121

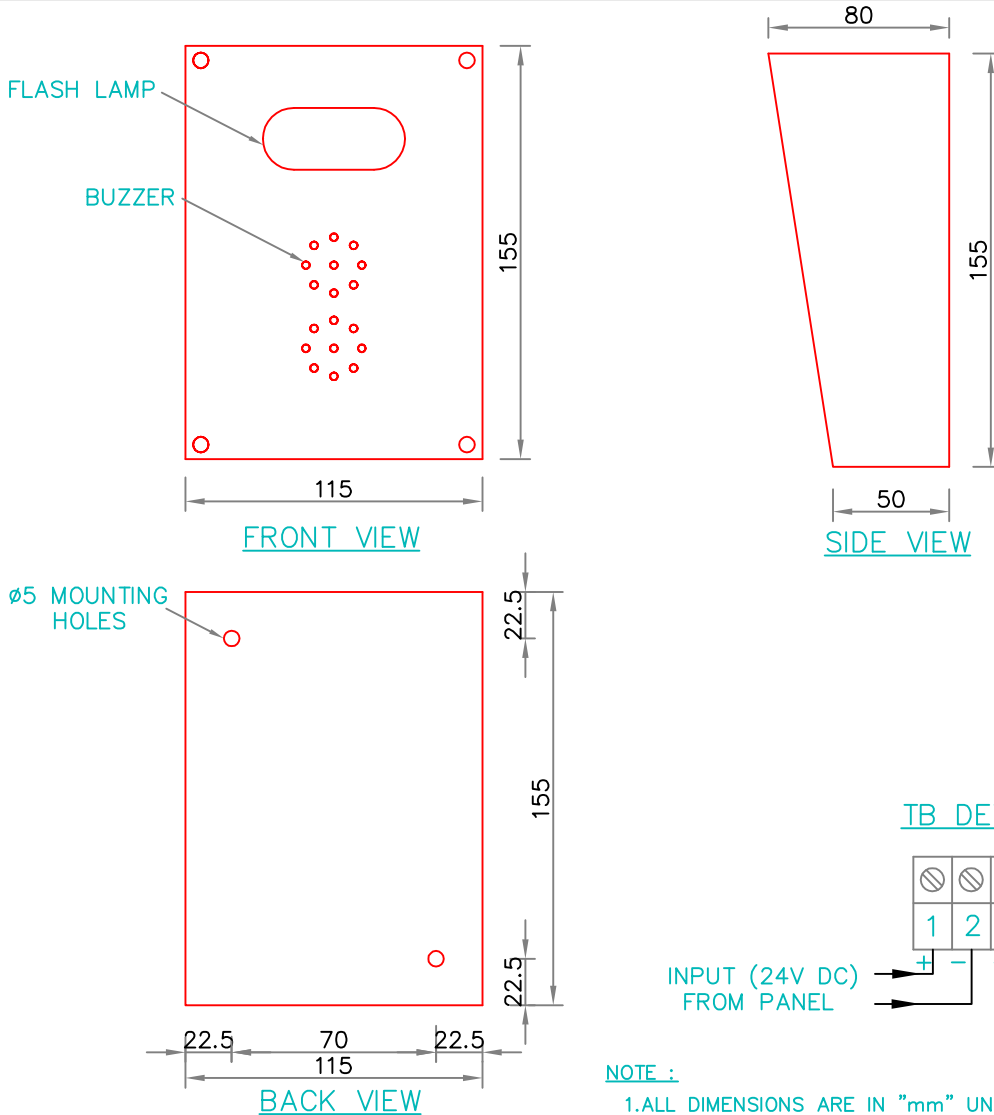

NOTE :
1. ALL DIMENSIONS ARE IN "mm" UNLESS OTHERWISE SPECIFIED.
2. TOLERANCE ON DIMENSION ± 3 MM, UNLESS OTHERWISE SPECIFIED.

TECHNICAL SPECIFICATION

01.	MAKE	balawa.. AGNICONROLS	07.	TYPE OF TONE	DUAL TONE
02.	OVER ALL DIMENSION	115(L) x 80(W)x 155(H)	08.	DB LEVEL	90<100 AT 24V DC AT 1M DISTANCE
03.	MATERIAL OF CONSTRUCTION	1.2mm (18 SWG) C.R SHEET	09.	FLASHING	RED LED
04.	FINISHING	PO RED	10.	CABLE ENTRY	BOTTOM ENTRY – ϕ 19mm KNOCK OUT
05.	WORKING VOLTAGE	24V DC	11.	TYPE OF MOUNTING	WALL MOUNTING
06.	CURRENT CONSUMPTION	350 mA MAX			

IMPORTANT:

AGNI CONTROLS RESERVES THE RIGHT TO CHANGE OR MODIFY WITHOUT PREVIOUS NOTICE ANY DATA OR SPECIFICATION DUE TO CHANGES OR MODIFICATION IN ORDER TO IMPROVE THE PRODUCTS / SYSTEM PRESENTED.



AGNI CONTROLS
CHENNAI

NO.1, 6TH STREET, Dr.SUBBARAYAN NAGAR,
KODAMBAKKAM, CHENNAI-600 024, INDIA.

PHONE : +91 44 2481 2420,

E-MAIL : engineering@agnicontrols.com WEBSITE : www.balafire.com

ISO 9001 - 2015
BUREAU VERITAS
CERTIFICATION