

DATA SHEET

RESPONSE INDICATOR DUAL LED

PART NO : IH150

OLD DWG. NO:DP-5.8/08-094
NEW DOC. NO:DP-5.8/MT-288

DATE : JUNE 2019

REV.: 01

SCALE : N.T.S


SHEET : 1 OF 1

APPD. BY : *[Signature]*

INTRODUCTION :-

RESPONSE INDICATOR IS USED ALONG WITH HEAT / SMOKE DETECTORS WHICH ARE INSTALLED IN FALSE FLOOR AND FALSE CEILING.

REV-01: REV-01 IS THE SAME AS REV-00 EXCEPT FOR ADDING ISO 9001:2015

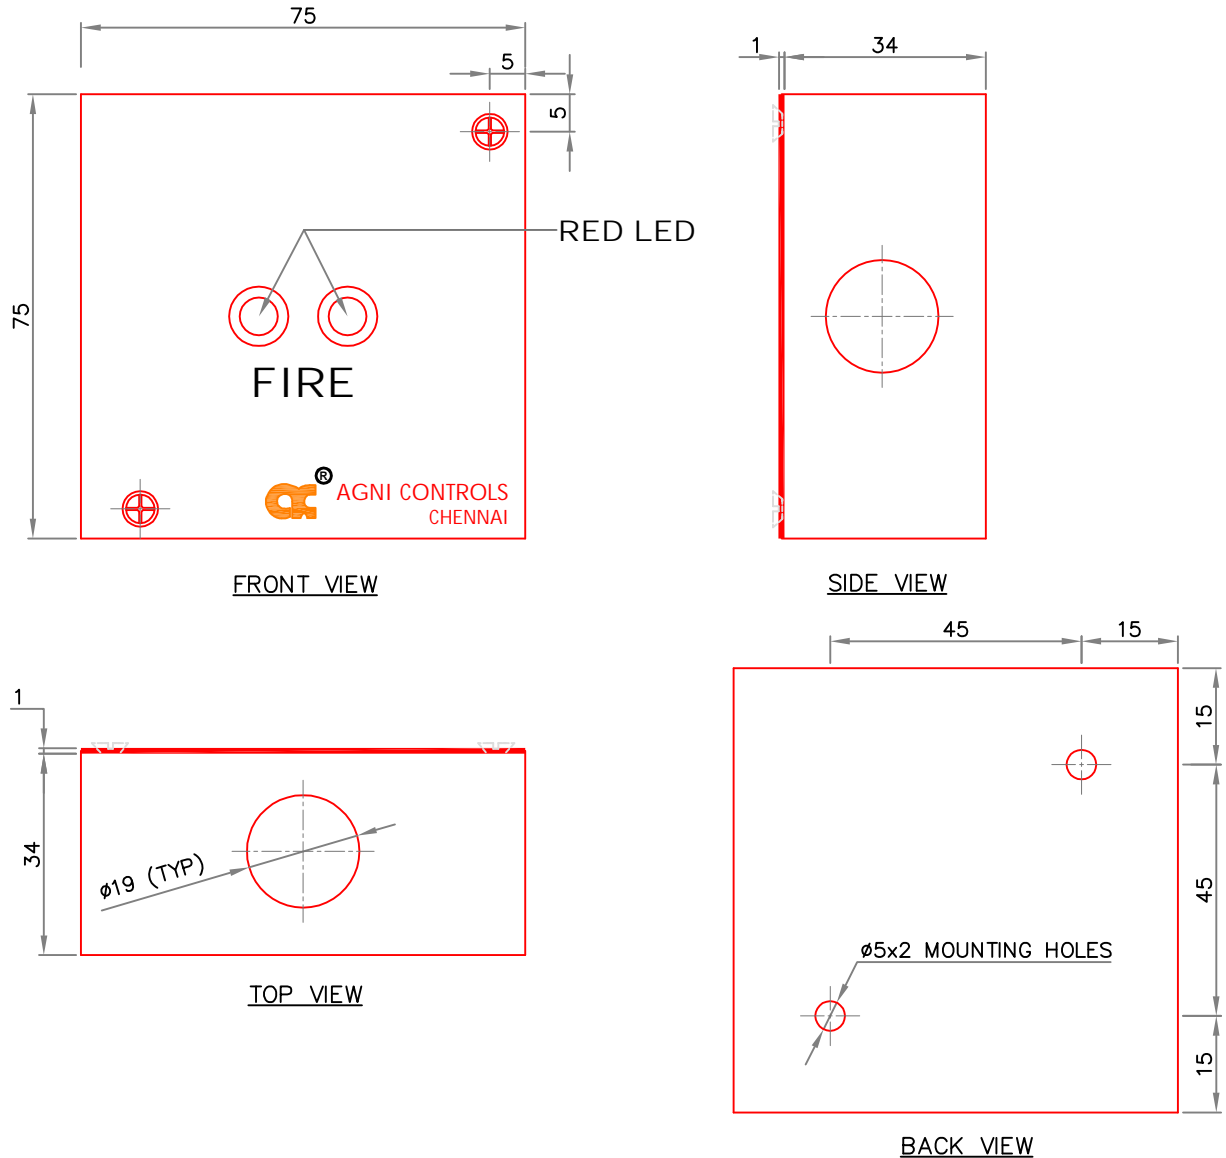

NOTE

1. ALL DIMENSIONS ARE IN "mm" UNLESS OTHERWISE SPECIFIED.
2. TOLERANCE ON DIMENSION ± 3 mm, UNLESS OTHERWISE SPECIFIED.

TECHNICAL SPECIFICATION

01.	CONSTRUCTION	(20 SWG) C.R SHEET	06.	TYPE OF MOUNTING	WALL/CEILING
02.	PAINTING PROCESS	POWDER COATING	07.	WORKING VOLTAGE	24V DC
03.	COLOUR	PO RED	08.	INDICATION	DUAL RED LED
04.	DIMENSION	75(L) x 35(W) x 75(H)			
05.	CABLE ENTRY	$\phi 19$ mm KNOCK OUT (ONE AT EACH SIDE.)			

IMPORTANT:

AGNI CONTROLS RESERVES THE RIGHT TO CHANGE OR MODIFY WITHOUT PREVIOUS NOTICE ANY DATA OR SPECIFICATION DUE TO CHANGES OR MODIFICATION IN ORDER TO IMPROVE THE PRODUCTS / SYSTEM PRESENTED.



NO.1, 6TH STREET, Dr.SUBBARAYAN NAGAR,
KODAMBAKKAM, CHENNAI-600 024, INDIA.

PHONE : +91 44 2481 2420, FAX : +91 44 2481 2475,
E-MAIL : engineering@agnicontrols.com WEBSITE : www.balafire.com

ISO 9001 - 2015
BUREAU VERITAS
CERTIFICATION