

**DATA SHEET**

**EXPLOSION PROOF FLASHING LAMP**

PART NO : IH345-AX

DOC.NO.: DP-5.8/MT-455

DATE: JUL 2016

REVISION : 00

SCALE : N.T.S


SHEET : 1 OF 1

APPD. BY :

INTRODUCTION :-

EXPLOSION PROOF FLASHING LAMP IS USED IN FIRE DETECTION & ALARM SYSTEM THROUGH FIRE ALARM PANEL.

NOTE A: THIS DATASHEET CAN BE ALSO REFERRED AS DP-5.8/CP-455.

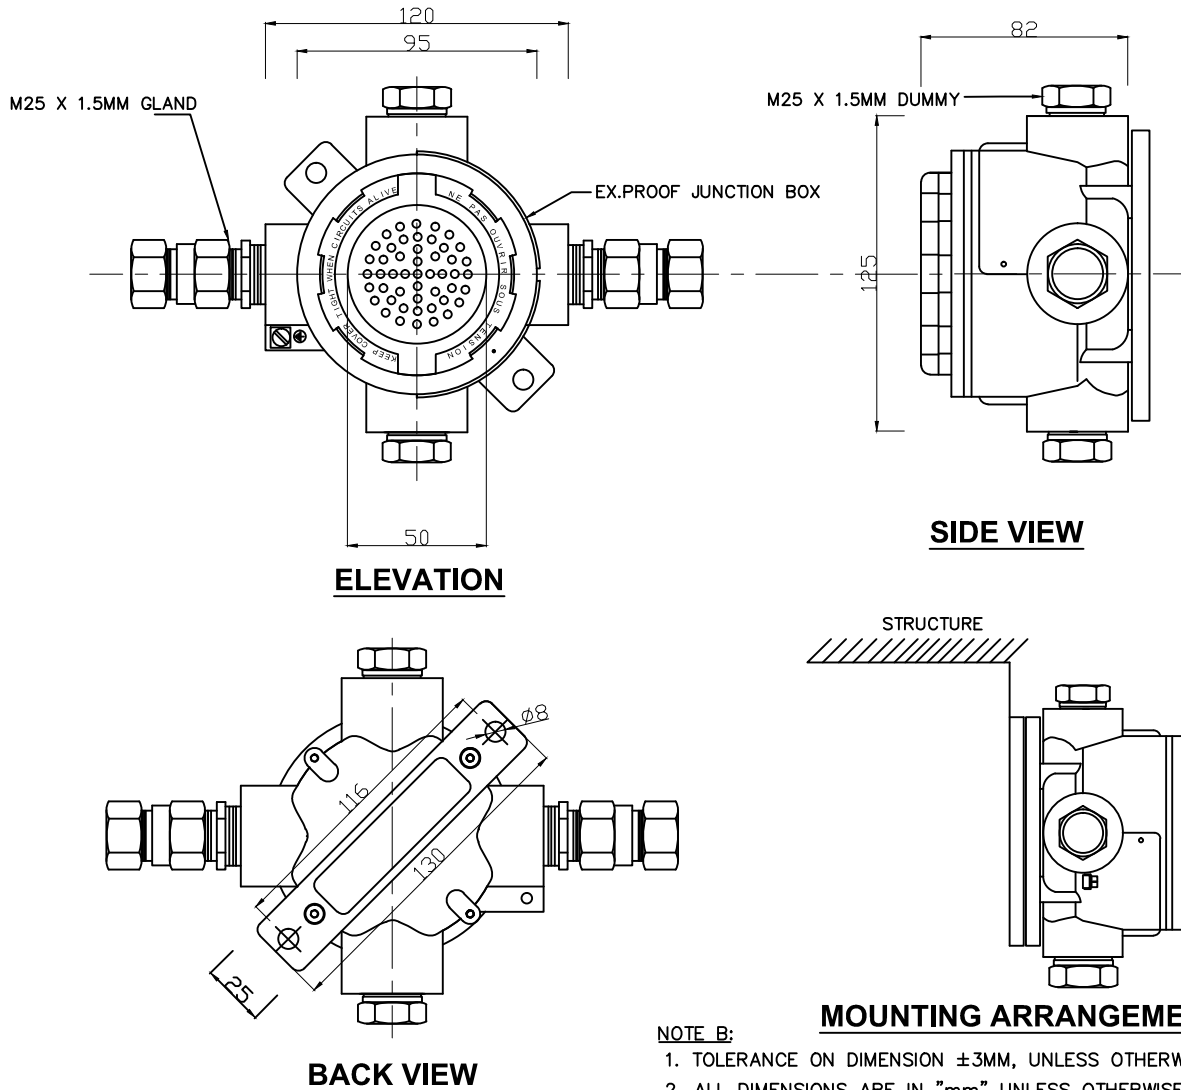

- NOTE B:**
1. TOLERANCE ON DIMENSION  $\pm 3$ MM, UNLESS OTHERWISE SPECIFIED.
  2. ALL DIMENSIONS ARE IN "mm" UNLESS OTHERWISE SPECIFIED.
  3. GLAND CONNECTION WITHOUT ADDITIONAL SEALING IP54.  
GLAND CONNECTION WITH ADDITIONAL SEALING IP67.

**TECHNICAL SPECIFICATION**

01.	MANUFACTURER	AGNI CONTROLS - CHENNAI	07.	ENCLOSURE MAKE	LIMATHERM EU
02.	INPUT SUPPLY	24V DC	08.	AREA CLASSIFICATION	ZONE 1,2,21 & 22
03.	PROTECTION CLASS	SEE NOTE B, 3rd POINT	09.	HAZARDOUS AREA	⊕ II 2G Ex d IIC Gb
04.	CURRENT CONSUMPTION	UPTO 100MA		PROTECTION DETAILS	⊕ II 2D Ex td IIIC Db
05.	CABLE ENTRY	M25 X 1.5MM	10.	CERTIFICATION FOR	FTZU 05 ATEX 0262U
06.	TYPE OF MOUNTING	WALL MOUNTING		ENCLOSURE	

IMPORTANT:

AGNI CONTROLS RESERVES THE RIGHT TO CHANGE OR MODIFY WITHOUT PREVIOUS NOTICE ANY DATA OR SPECIFICATION DUE TO CHANGES OR MODIFICATION IN ORDER TO IMPROVE THE PRODUCTS / SYSTEM PRESENTED.



NO.1, 6TH STREET, Dr.SUBBARAYAN NAGAR,  
KODAMBAKKAM, CHENNAI-600 024, INDIA.

PHONE : +91 44 2382 0774, FAX : +91 44 2481 2475,  
E-MAIL : operation@agnicontrols.com WEBSITE : www.balafire.com

**ISO 9001 - 2000  
CERTIFIED BY  
BUREAU VERITAS**